



March 27, 2026

San Simeon Community Services District
111 Pico Avenue
San Simeon, CA 93452

**SUBJECT: MARCH 2026 MONTHLY FACILITY REPORT FOR THE SAN SIMEON COMMUNITY SERVICES DISTRICT
WASTEWATER TREATMENT PLANT, WATER SYSTEM, AND COLLECTION SYSTEM**

WASTEWATER TREATMENT PLANT

On March 9, 2026, staff performed sampling for routine MLSS calibrations at the wastewater treatment plant.

Staff completed routine quarterly inspections and maintenance checks on March 25, 2026; nothing unusual was noted for the system.

WATER SYSTEM

Staff completed the installation of a dedicated routine Sample Station (SS #1) on March 9, 2026, which was required by the 2025 Sanitary Survey Report received from State Water Resources Control Board (SWRCB) staff in December 2025.

Due to the Amended PFAS General Order DW-2022-0001-DDW that was issued by the SWRCB on January 29, 2026, required PFOA/PFOS samples were collected by the analytical laboratory on March 24, 2026. Staff are awaiting the final results from the laboratory at the time of preparing this report.

A repair was made to the water treatment plant discharge line due to a leak, and required bacteriological samples were collected on March 26, 2026. Staff are awaiting the final report from the laboratory at the time of preparing this report, but results are anticipated to be Non-Detect for all coliforms based on preliminary draft results available at this time.

COMPLIANCE

The routine regulator inspection for the wastewater treatment plant was conducted with SWRCB staff on March 4, 2026. SWRCB staff will provide a formal report with any action items to FRM and SMCSO; no items requiring immediate attention nor any violations were noted during the inspection.

Staff compiled the data to complete the monthly Self-Monitoring Report (SMR) in California Integrated Water Quality System (CIWQS). Once approved, the reports are uploaded into CIWQS and certified by SSCSD Staff.

Sincerely,
FLUID RESOURCE MANAGEMENT



San Simeon CSD Wastewater Treatment Facility

Monthly report due first day of second month
following monitoring period

Month: MARCH 2026

Annual report due January 30

Date	Influent Flow Total (GPD)	Effluent Flow Total (GPD)	Effluent Monitoring					
			Biweekly Total Coliform	Biweekly Fecal Coliform	Biweekly Enterococcus	Daily Settleable Solids (mL/L)	Daily Chlorine Used (lbs)	Daily Chlorine Residual (mg/L)
1	89,957	99,640				<0.1	111.4	0.06
2	65,027	68,610				<0.1	74.8	0.03
3	65,049	65,598	<1.8	<1.8	<1.0	<0.1	155.1	0.02
4	43,270	44,672	<1.8	<1.8	<1.0	<0.1	111.4	0.00
5	44,225	45,300				<0.1	131.3	0.03
6	48,879	48,250				<0.1	238.7	0.02
7	43,677	42,540				<0.1	59.7	0.03
8	67,499	62,380				<0.1	127.3	0.03
9	62,514	57,690				<0.1	71.6	0.03
10	55,352	51,050	<1.8	<1.8	<1.0	<0.1	179.0	0.04
11	40,795	36,040	<1.8	<1.8	<1.0	<0.1	206.9	0.04
12	61,405	55,550				<0.1	89.6	0.04
13	42,093	38,830				<0.1	35.8	0.03
14	48,856	42,760				<0.1	116.8	0.03
15	70,874	58,690				<0.1	167.1	0.02
16	61,573	50,060				<0.1	105.2	0.02
17	62,141	56,510	<1.8	<1.8	<1.0	<0.1	214.8	0.03
18	35,561	36,010	<1.8	<1.8	<1.0	<0.1	155.0	0.02
19	51,399	48,390				<0.1	117.0	0.03
20	56,348	50,740				<0.1	112.8	0.03
21	60,081	55,930				<0.1	115.4	0.01
22	62,805	53,830					99.5	0.05
23	67,759	56,700					103.4	0.03
24	65,107	54,790					167.1	0.03
25	44,265	38,990					103.4	0.00
26	56,169	45,980					163.1	0.04
27								
28								
29								
30								
31								
Min	35,561	36,010	<1.8	<1.8	<1.0	<0.1	35.8	0.00
Mean	56,641.5	52,520.4	<1.8	<1.8	<1.0	<0.1	128.2	0.03
Max	89,957	99,640	<1.8	<1.8	<1.0	<0.1	238.7	0.06
Total	1,472,680	1,365,530						

Effluent average dry weather flow NTE a monthly average of 0.2 MGD.

Effluent and Influent Monitoring

Date	Monthly Effluent BOD (24 HC)	Monthly Effluent TSS (24 HC)	Monthly Influent BOD (24 HC)	Monthly Influent TSS (24 HC)
3/3/26	<4.0	<5.0	210	200
BOD Removal: 100.0%		TSS Removal: 100.0%		

Effluent Monitoring

Date	Weekly Dissolved Oxygen (Grab)	Weekly Turbidity (Grab)	Weekly pH (Grab)	Weekly Temp °F (Grab)
3/3/26	5.3	2.6	7.02	68.2
3/10/26	6.7	1.0	6.88	68.0
3/17/26	5.0	1.6	6.84	70.1
3/24/26				
Min	5.0	1.0	6.84	68.0
Mean	5.7	1.7	6.91	68.8
Max	6.7	2.6	7.02	70.1

Sludge Removal

Date	Gallons
N/A	N/A

Influent Brine Received

Date	Gallons
N/A	N/A

Semi-Annual Effluent Oil & Grease

Date	Result (mg/L)
1/20/26	<5.0
July	---

Effluent Limits

Parameter	Units	Monthly Avg	Weekly Avg	Daily Max
BOD	mg/L	30	45	90
Suspended Solids	mg/L	30	45	90
Oil and Grease	mg/L	25	40	75
Turbidity	NTU	75	100	225
Total Coliform	MPN/100 mL	30 Day Geometric Mean: 230		
		Daily Maximum: 2,400		
Chlorine Residual	mg/L	6 Month Median: 0.23		0.93
		Instantaneous Maximum: 6.9		
pH	pH units	Between 6.0 - 9.0		
Settleable Solids	mL/L	1.0	1.5	3.0
BOD/TSS Removal	%	≥ 85%	***	***

I certify under penalty of perjury that the foregoing is true and accurate and that the sampling procedure and analysis used are as specified in the Waste Discharge Order for this facility.

SIGNATURE: _____

DATE: _____

PRINTED NAME: _____


TITLE: _____

SAN SIMEON CSD AVERAGE DAILY EFFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
EFFLUENT DRY WEATHER AVERAGE DAILY FLOW LIMIT	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000
2024	69,123	108,920	79,757	74,812	63,117	68,885	76,021	70,269	62,465	53,768	53,148	58,262
2025	44,231	64,372	60,786	63,575	55,226	46,911	57,893	36,023	51,005	42,481	57,625	51,907
2026	62,468	68,708	52,520									

SSCSD AVERAGE DAILY WWTP EFFLUENT FLOW

■ 2024
 ■ 2025
 ■ 2026
 — Permit Limit

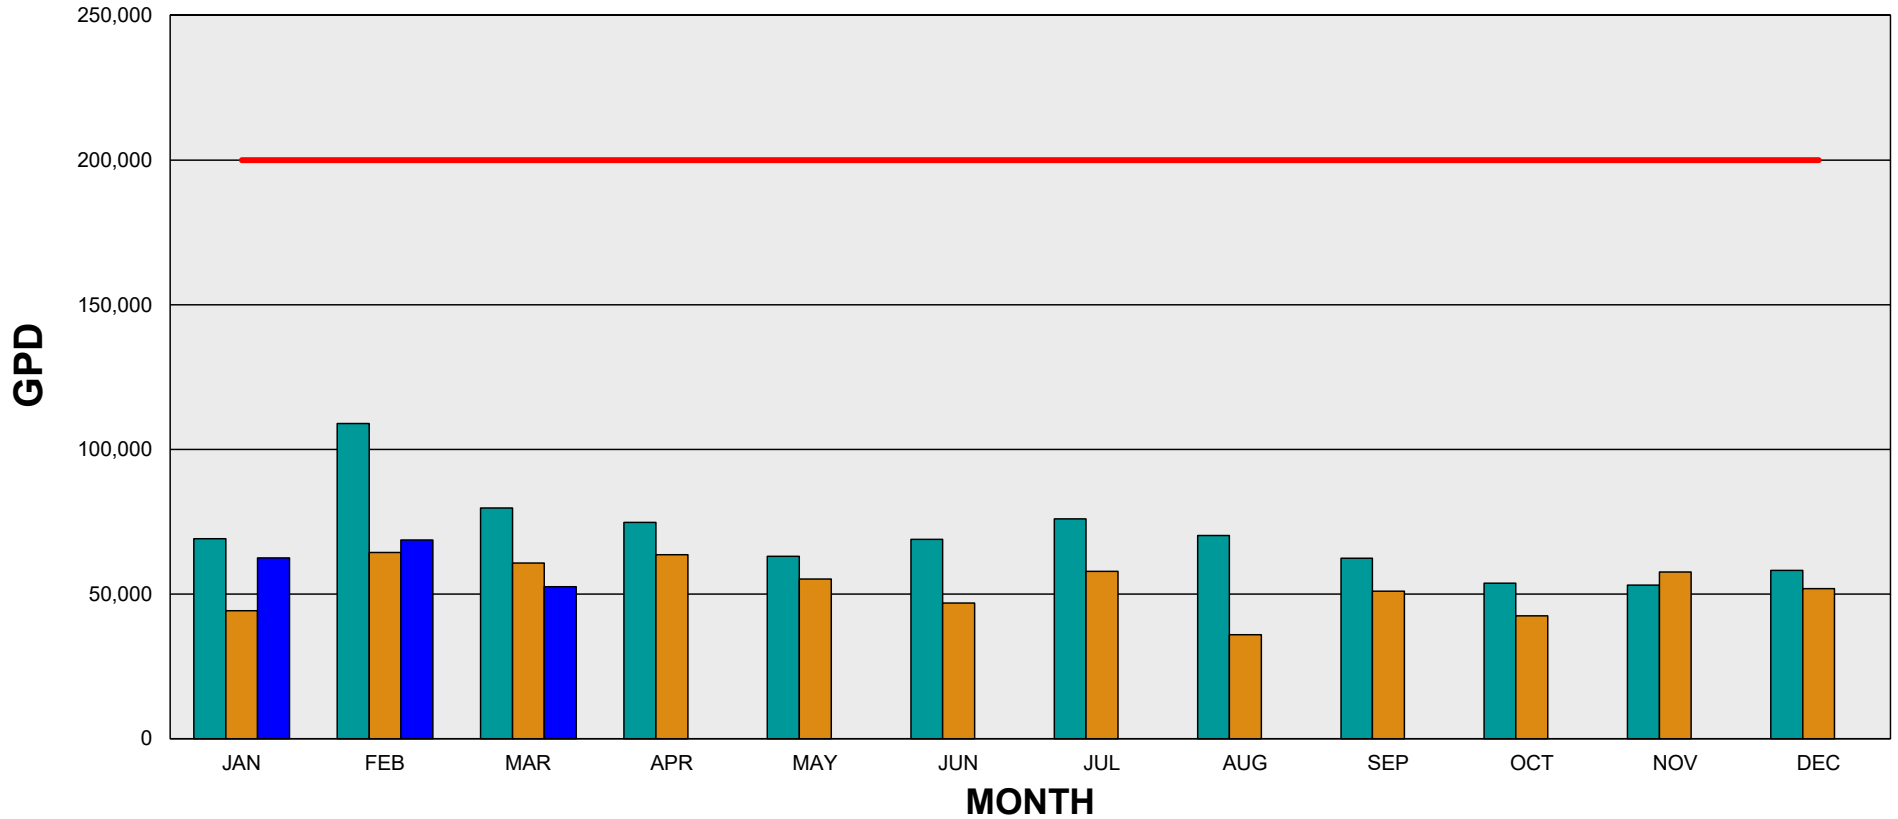


Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL EFFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	1,936,510	1,923,820	1,365,530									

SSCSD MONTHLY TOTAL WWTP EFFLUENT FLOW

■ 2024
 ■ 2025
 ■ 2026

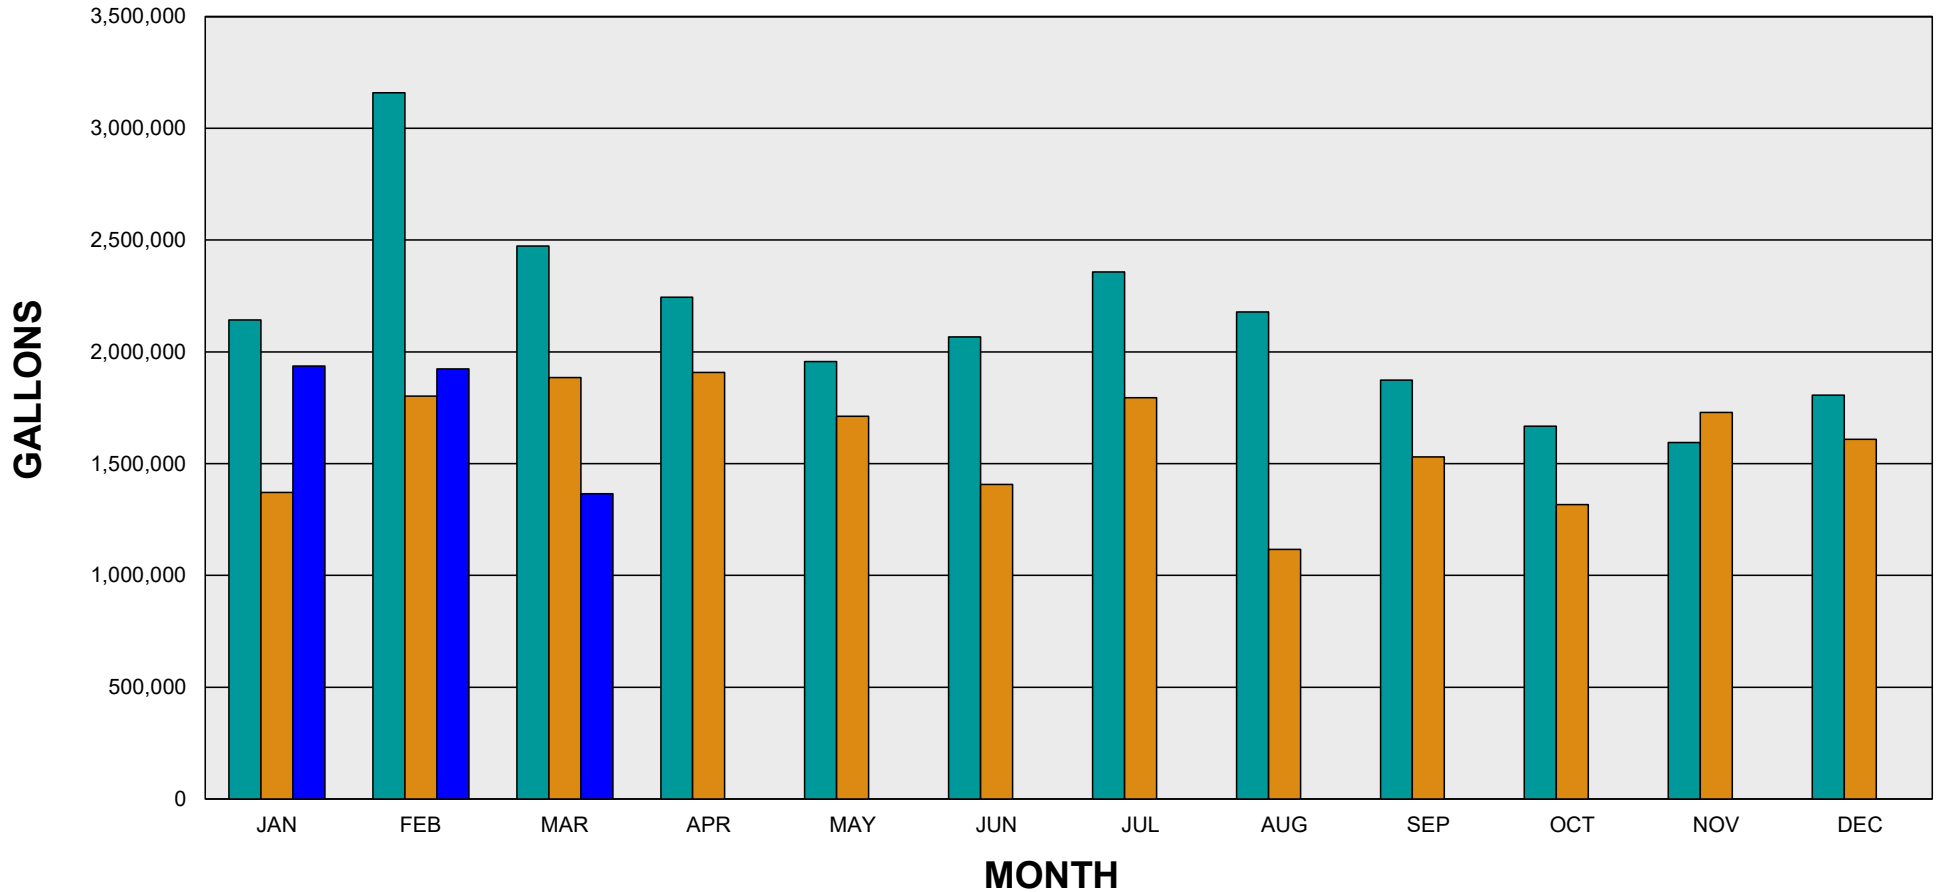


Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD AVERAGE DAILY INFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	73,426	115,645	81,673	76,105	61,541	67,958	75,673	70,547	61,328	51,160	48,404	57,507
2025	42,268	61,220	58,891	56,049	55,635	61,765	69,394	62,696	60,055	54,337	60,496	56,579
2026	69,567	72,076	56,642									

SSCSD AVERAGE DAILY WWTP INFLUENT FLOW

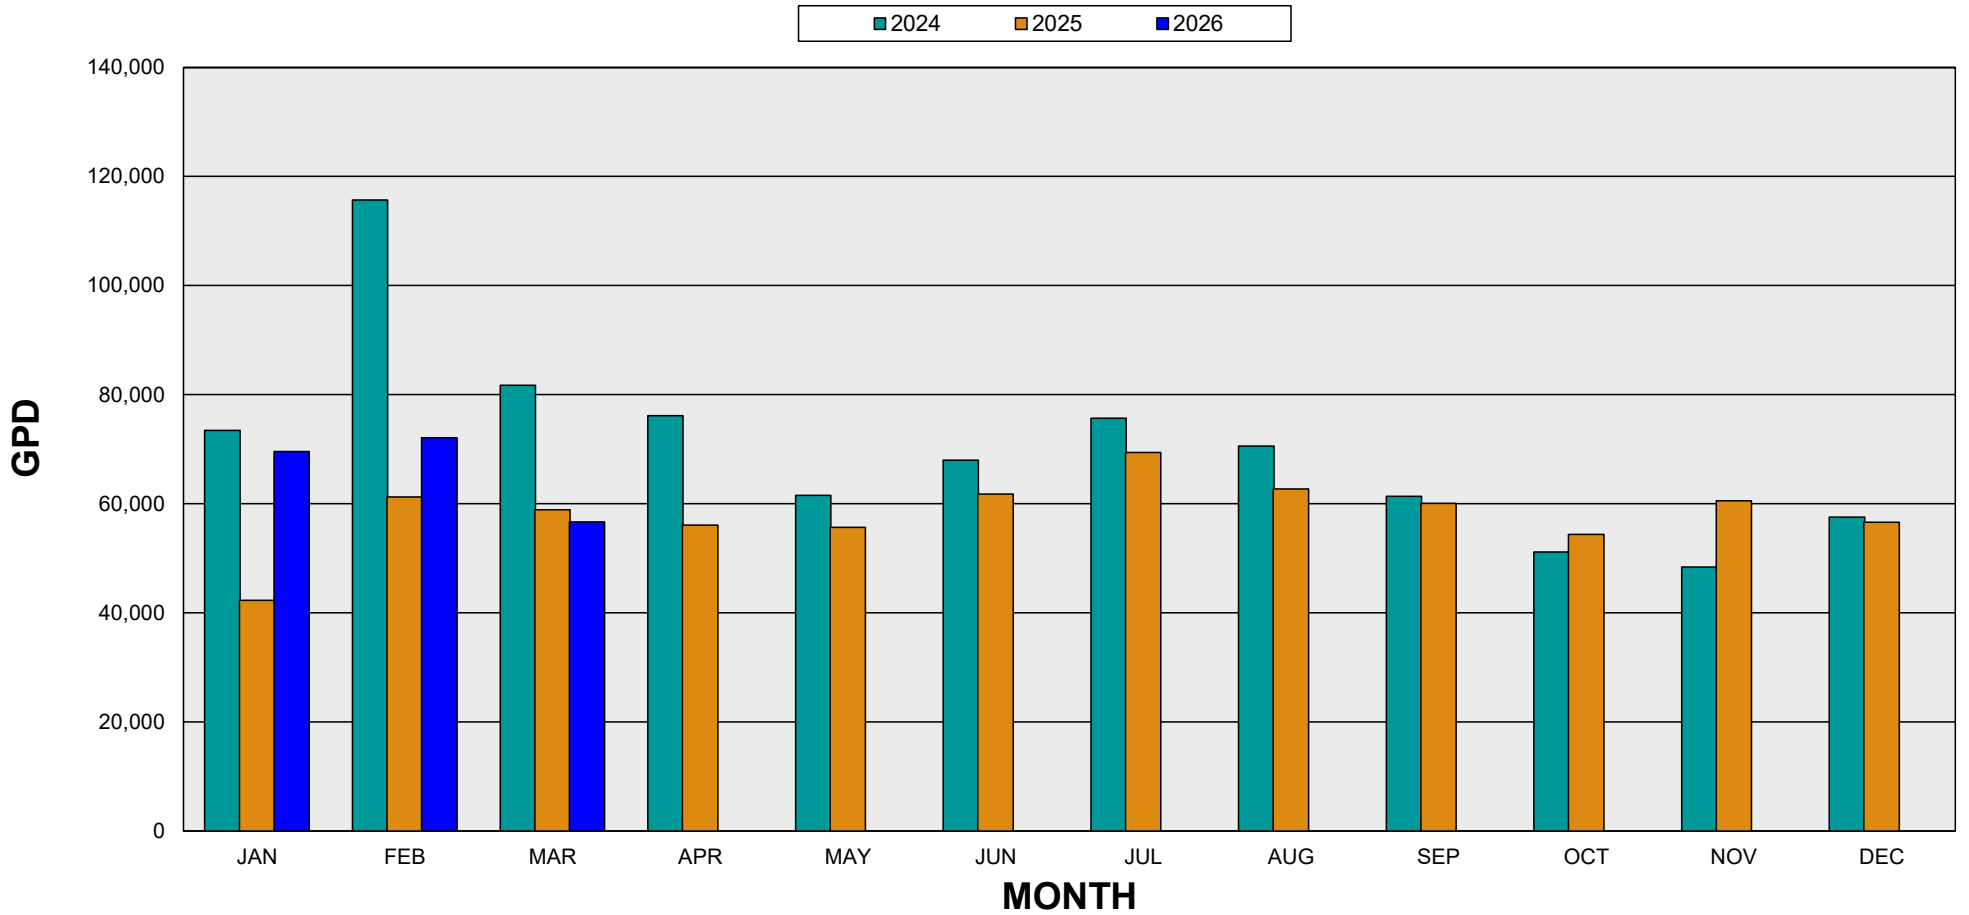


Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL INFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,276,191	3,353,693	2,531,854	2,283,155	1,907,760	2,038,747	2,345,876	2,186,946	1,839,831	1,633,973	1,534,789	1,782,722
2025	1,310,305	1,714,171	1,825,606	1,681,465	1,724,693	1,852,964	2,151,214	1,943,565	1,801,654	1,684,454	1,814,894	1,753,949
2026	2,156,572	2,018,115	1,472,680									


SSCSD MONTHLY TOTAL WWTP INFLUENT FLOW

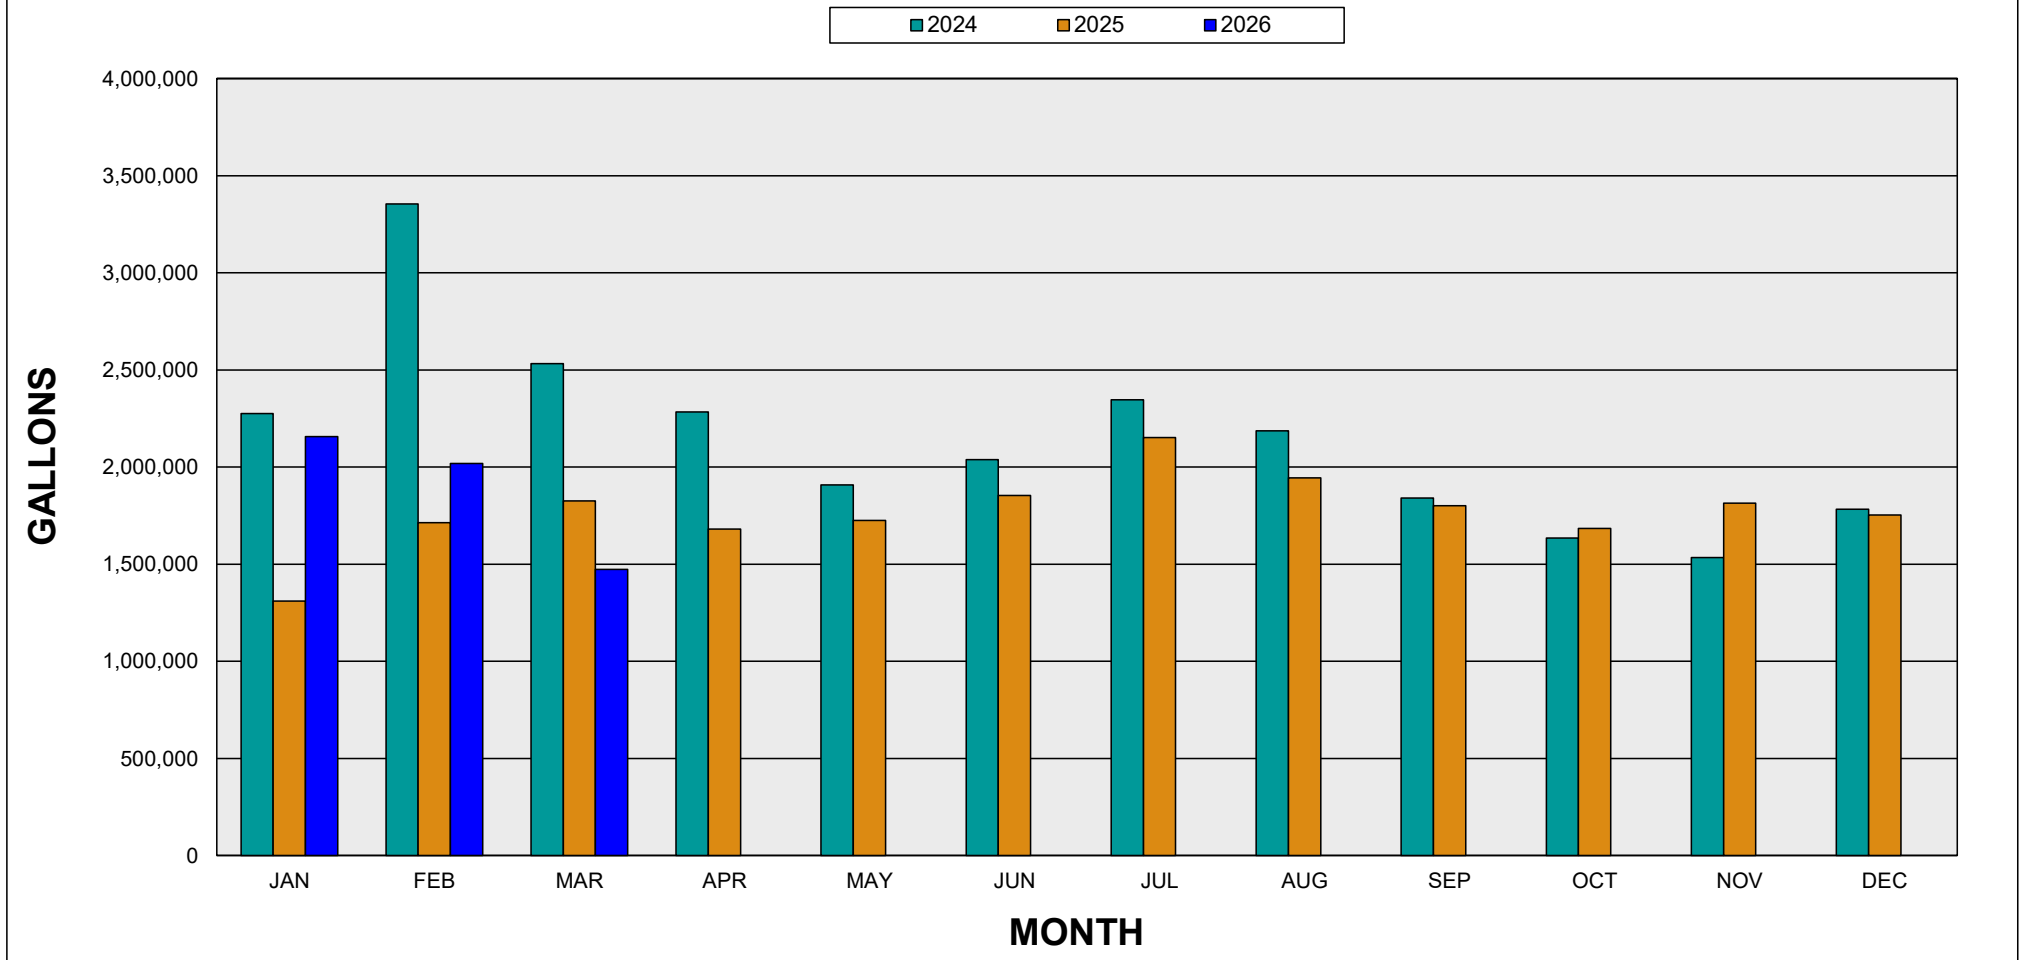

Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD TREATED WATER PRODUCED (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,776,950
2025	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
2026	1,679,335	1,789,216	1,626,302									

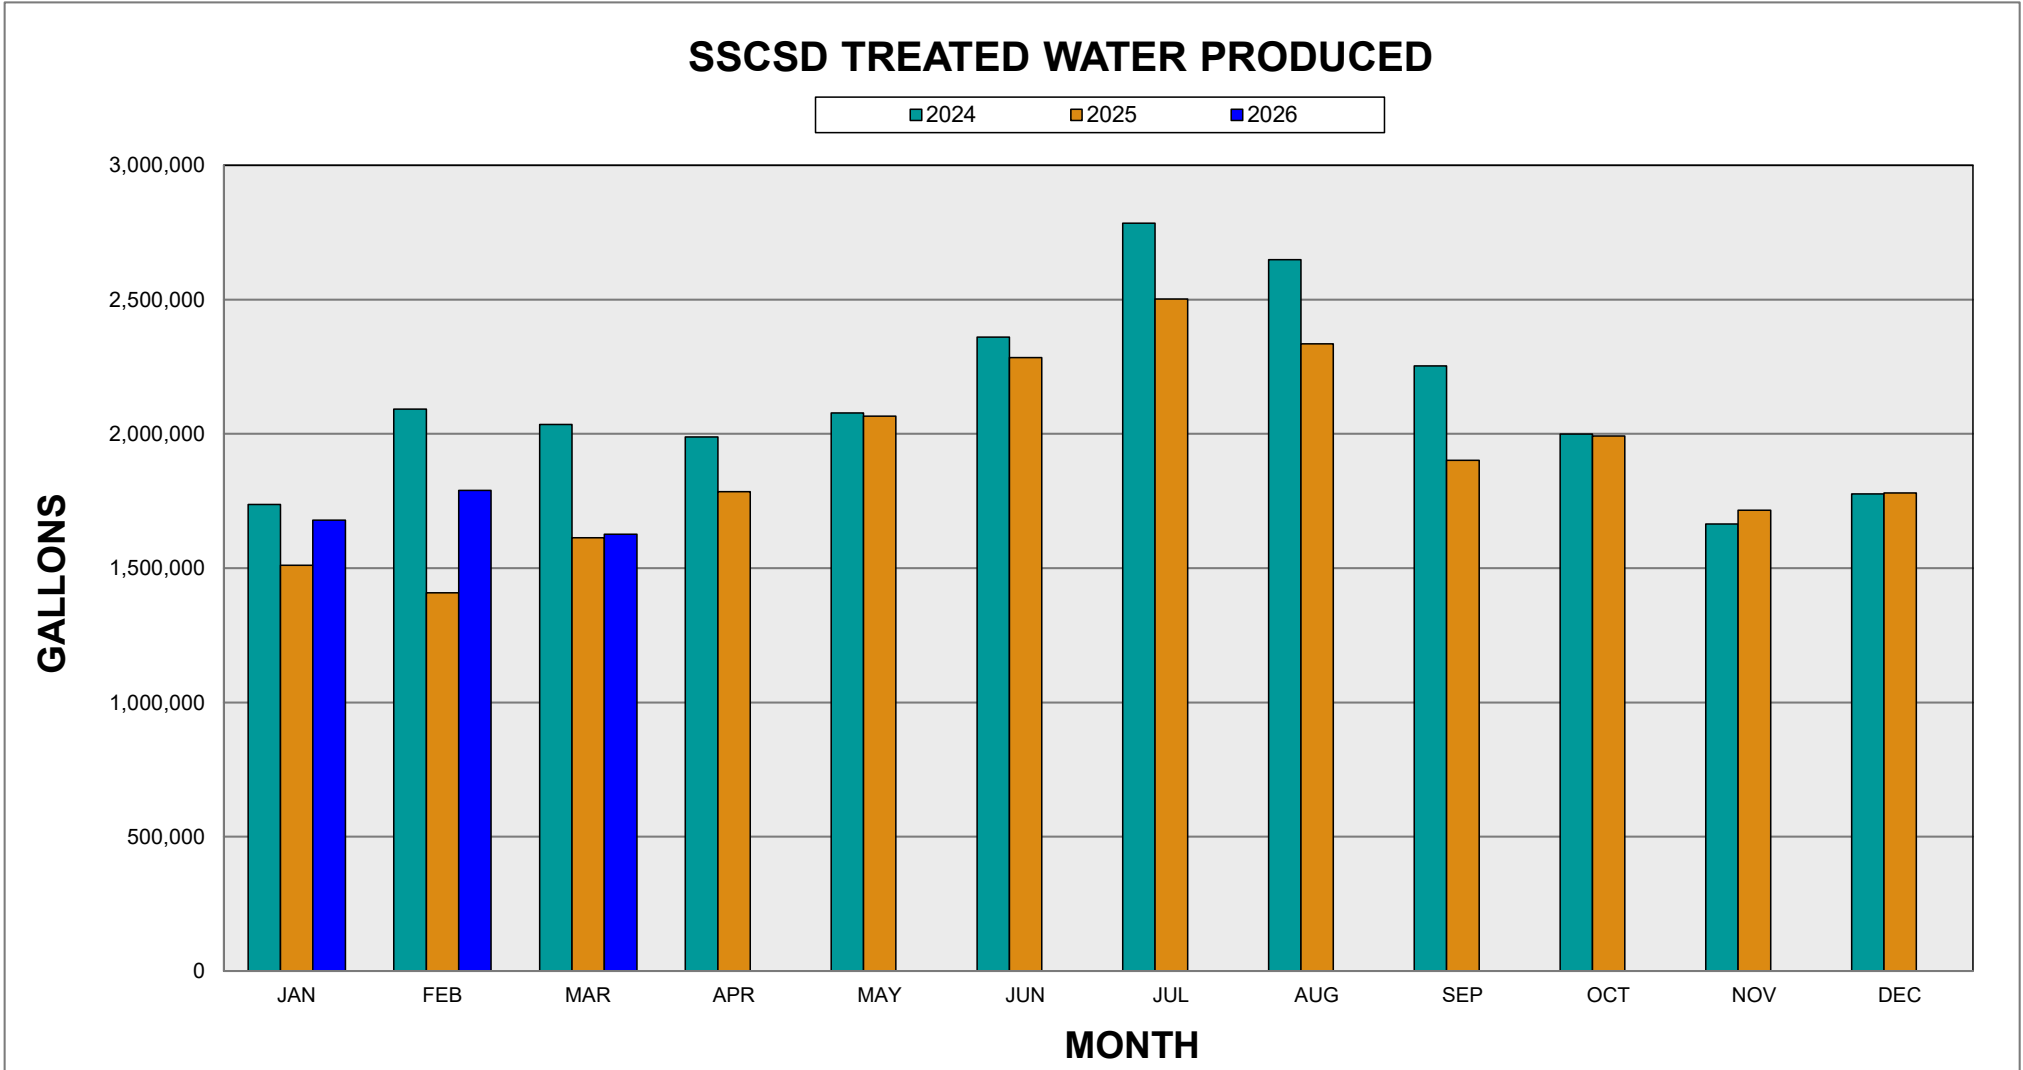


Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD TOTAL WATER SOLD (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,333,721	1,793,929	1,861,122	1,437,461	1,985,933	1,852,901	2,368,923	2,297,550	1,957,965	2,021,356	1,664,674	1,504,729
2025	1,615,807	1,393,330	1,487,809	1,584,795	1,914,865	1,767,733	2,811,321	2,153,470	1,701,992	1,672,835	1,220,856	1,850,141
2026	1,352,339	1,381,122										

SSCSD TOTAL WATER SOLD


■ 2024
 ■ 2025
 ■ 2026

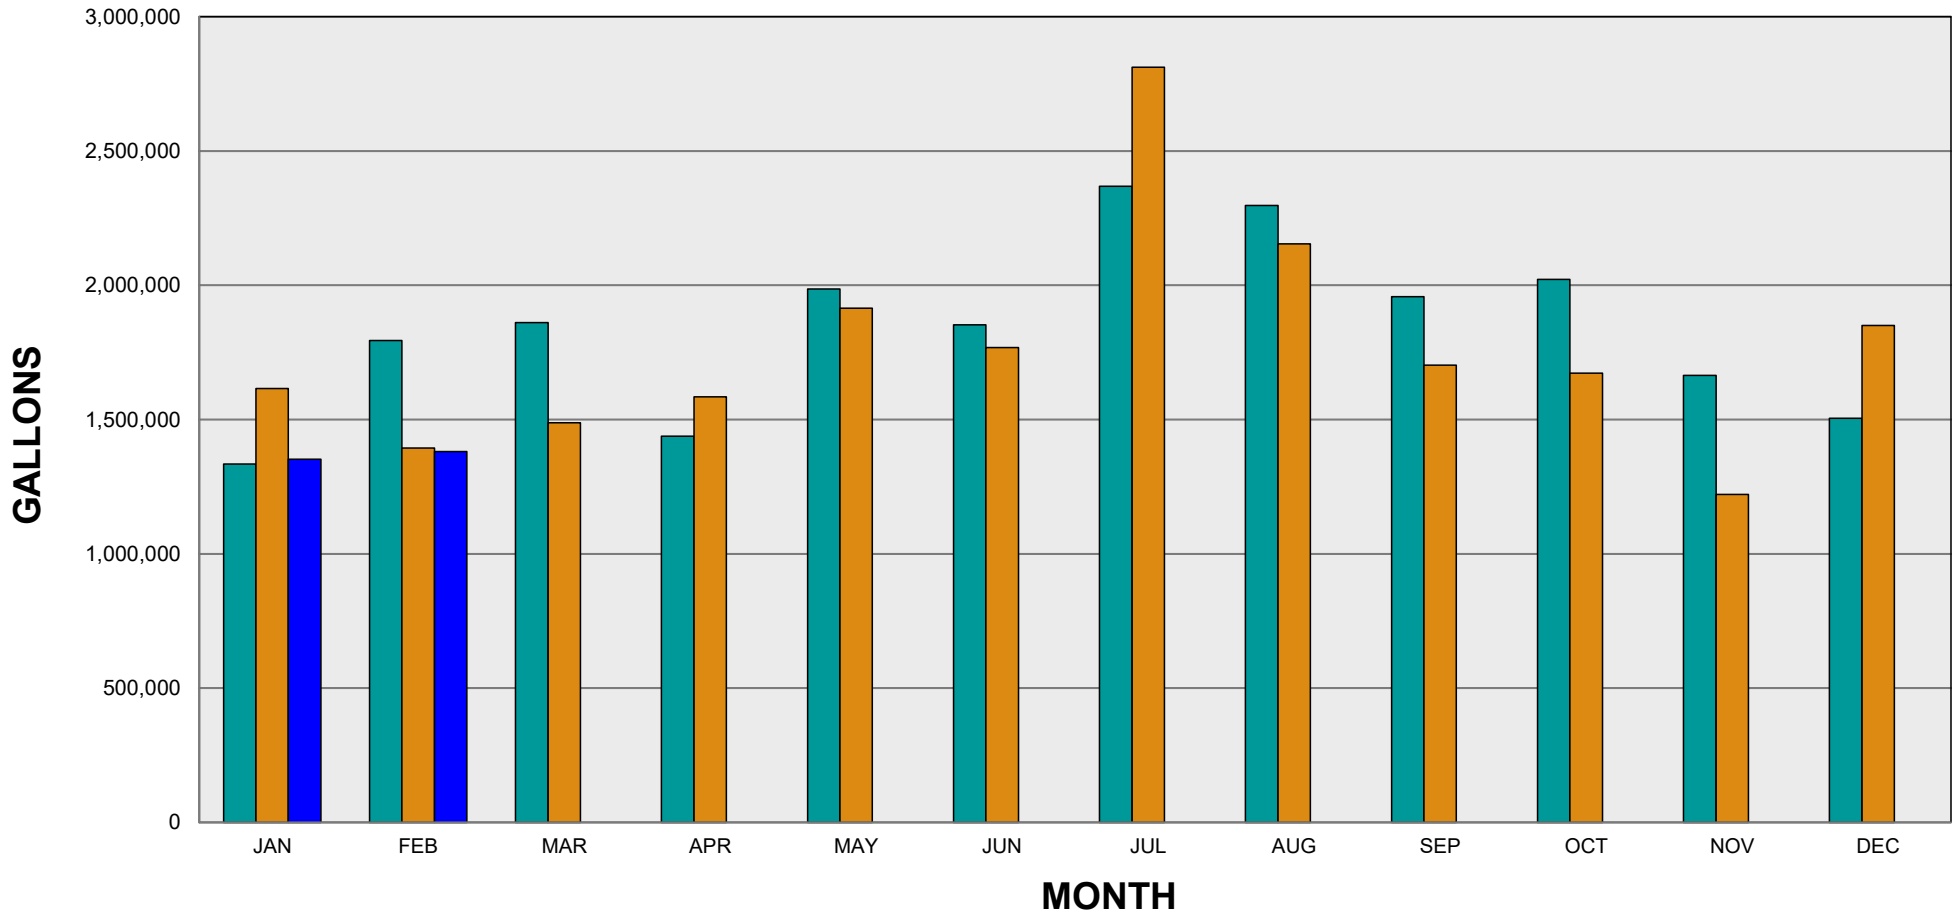

Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD WASTEWATER TREATMENT PLANT WATER USED (GALLONS)



MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	---	---	---	---	---	---	---	---	---	14,519	5,887	8,932
2025	6,082	6,815	9,119	6,665	7,870	7,047	7,555	6,456	28,815	6,747	6,112	7,548
2026	5,558	5,461	5,498									

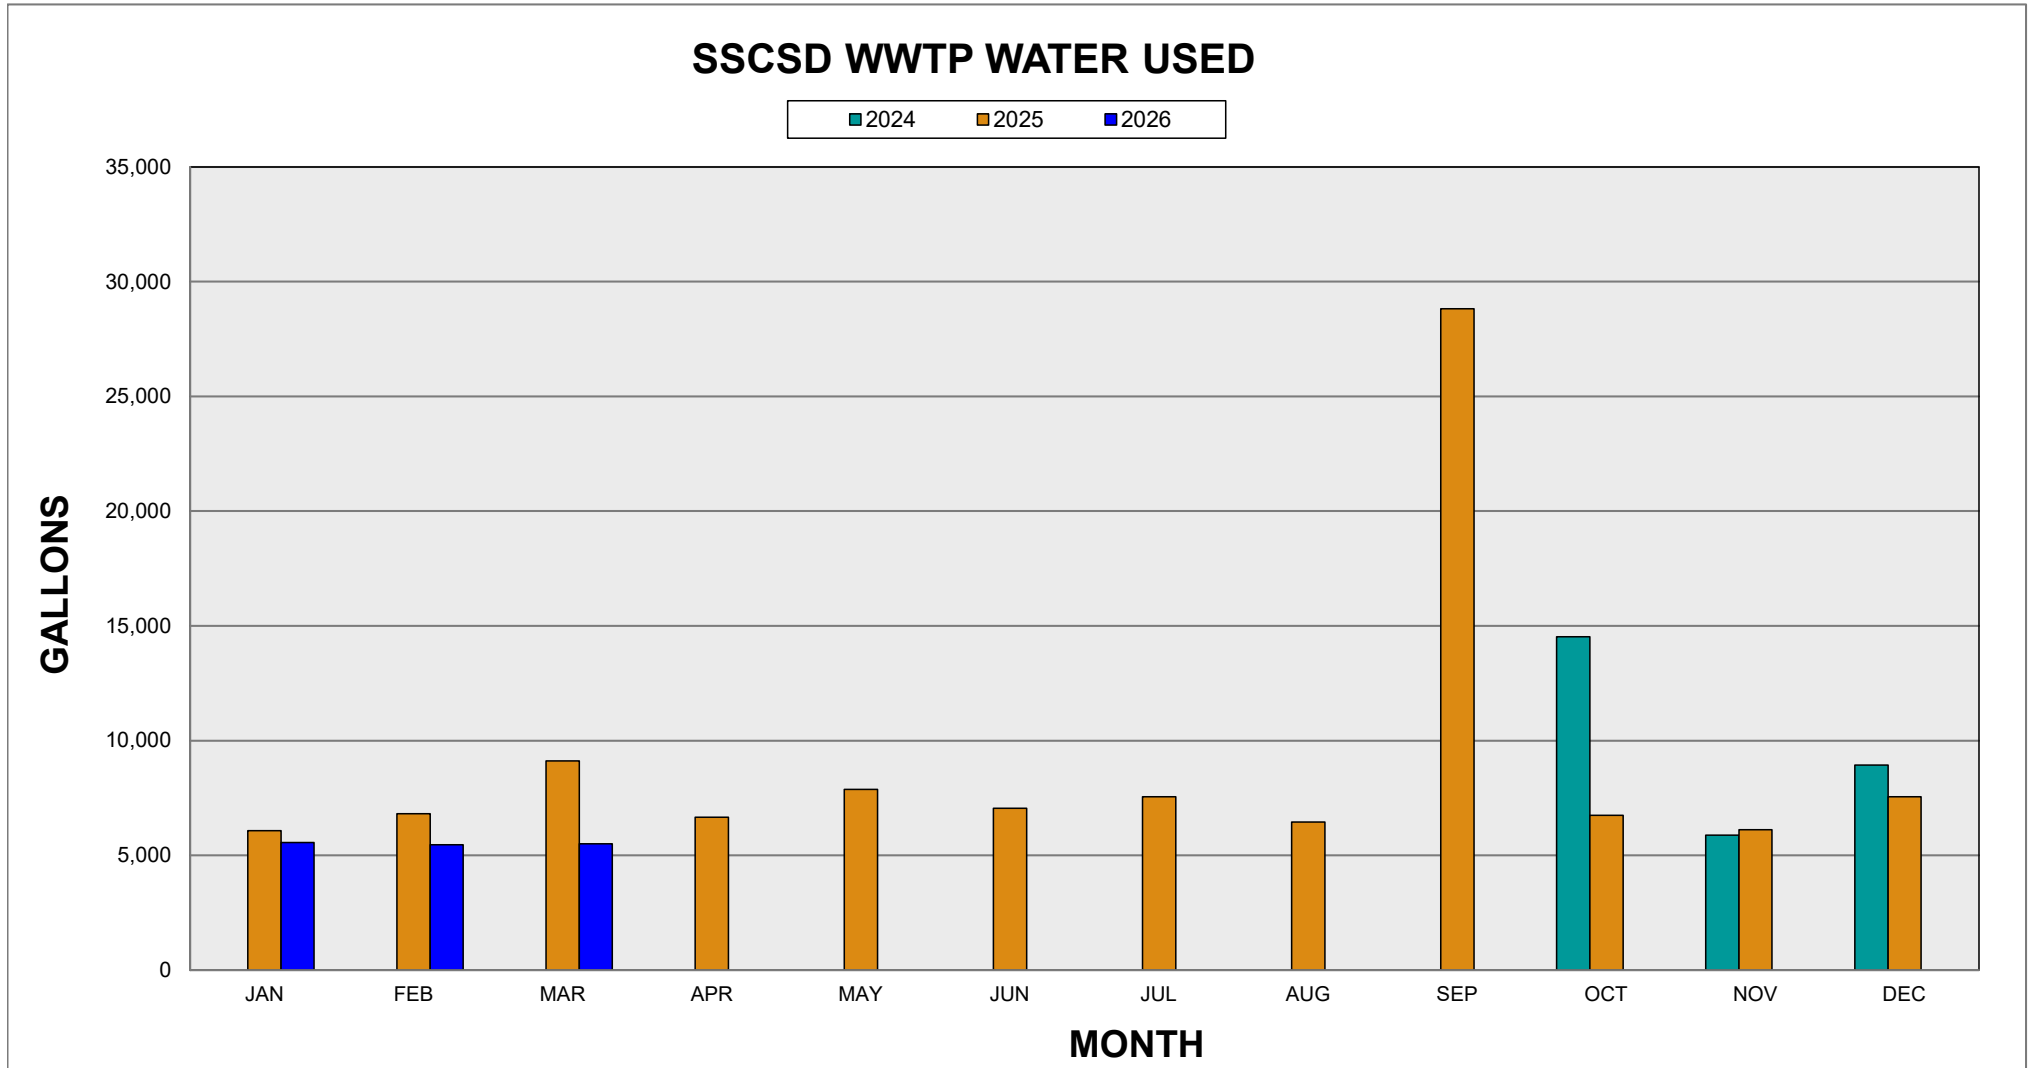

Data for this report is current up to 3/27, and is subject to change for future reporting.

SAN SIMEON CSD PRODUCTION DATA (GALLONS)

2023	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	---	---	---	---	---	---	---	---	2,187,977	2,207,872	1,951,981	2,103,226
TOTAL EFFLUENT FLOW (GAL)	---	---	---	---	---	---	---	---	1,873,570	1,951,950	1,830,260	2,114,900
2024	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,845,466
TOTAL EFFLUENT FLOW (GAL)	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
TOTAL EFFLUENT FLOW (GAL)	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,679,335	1,789,216	1,626,302									
TOTAL EFFLUENT FLOW (GAL)	1,936,510	1,923,820	1,365,530									

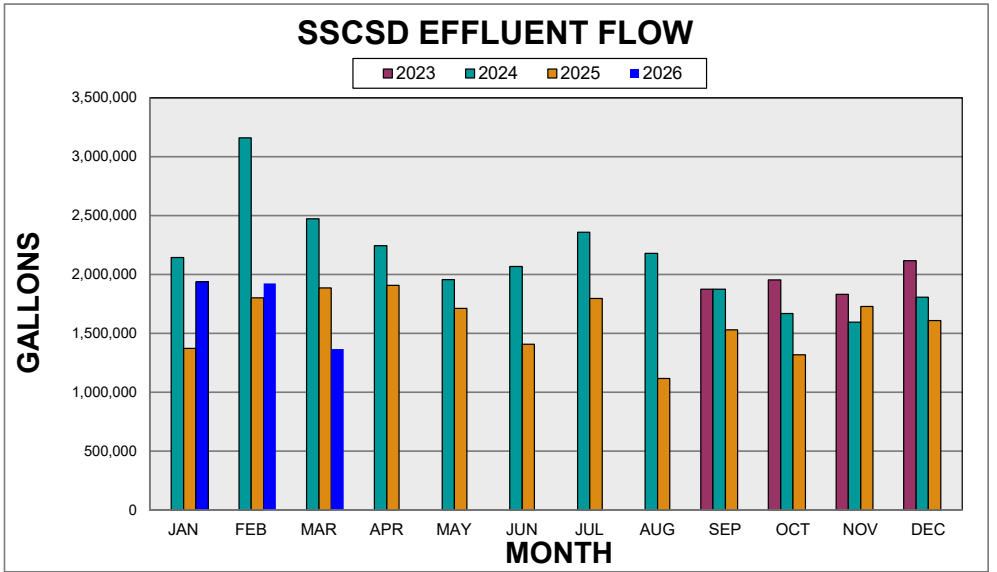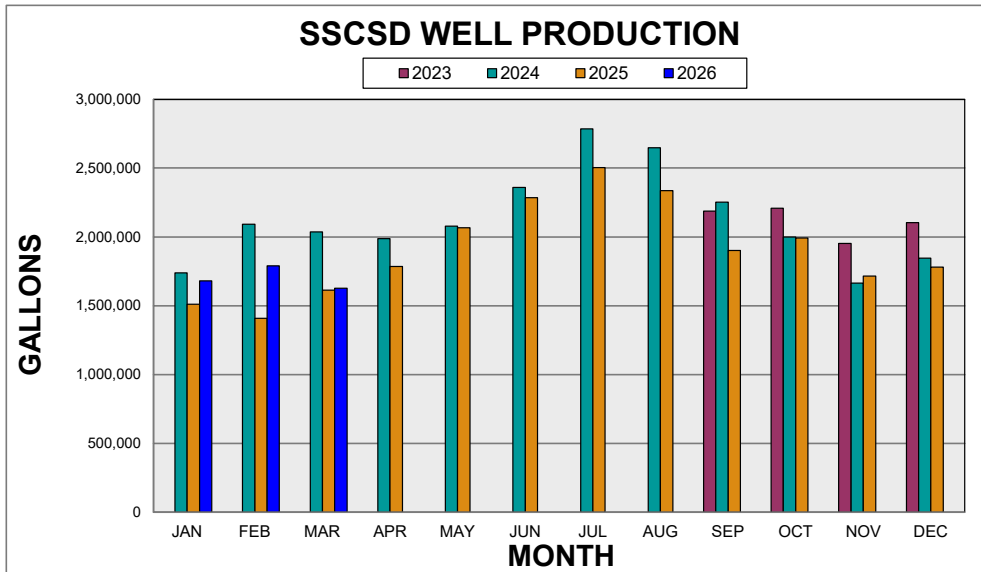

Data for this report is current up to 3/27, and is subject to change for future reporting.