



April 30, 2026

San Simeon Community Services District  
111 Pico Avenue  
San Simeon, CA 93452

**SUBJECT: APRIL 2026 MONTHLY FACILITY REPORT FOR THE SAN SIMEON COMMUNITY SERVICES DISTRICT  
WASTEWATER TREATMENT PLANT, WATER SYSTEM, AND COLLECTION SYSTEM**

**WASTEWATER TREATMENT PLANT**

Contractors began replacing sections of fencing on the east side of the wastewater treatment plant property on April 28, 2026.

**WATER SYSTEM**

Due to a service line leak, staff isolated the main line and shut off water to Balboa Avenue on April 1, 2026. Staff repaired the leak and restored water service on April 2, 2026.

**COMPLIANCE**

Staff updated the Cross Connection Control Program (CCCP) to reflect the newly established legal authority for the system, and this revision was approved by Regional Water Board staff on April 8, 2026.

Staff compiled the data to complete the monthly Self-Monitoring Report (SMR) in California Integrated Water Quality System (CIWQS). Once approved, the reports are uploaded into CIWQS and certified by SSCSD Staff.

Sincerely,  
**FLUID RESOURCE MANAGEMENT**



# San Simeon CSD Wastewater Treatment Facility

Monthly report due first day of second month  
following monitoring period

Month: **APRIL 2026**

Annual report due January 30

Date	Influent Flow Total (GPD)	Effluent Flow Total (GPD)	Effluent Monitoring					
			Biweekly Total Coliform	Biweekly Fecal Coliform	Biweekly Enterococcus	Daily Settleable Solids (mL/L)	Daily Chlorine Used (lbs)	Daily Chlorine Residual (mg/L)
1	73,501	75,390	<1.8	<1.8	1.0	<0.1	159.1	0.01
2	76,272	77,330				<0.1	163.7	0.04
3	61,904	65,950				<0.1	126.5	0.02
4	59,839	64,630				<0.1	131.3	0.04
5	85,319	88,670				<0.1	147.2	0.00
6	61,738	67,000	<1.8	<1.8	<1.0	<0.1	166.3	0.02
7	59,661	60,740	<1.8	<1.8	<1.0	<0.1	115.4	0.04
8	57,588	58,830				<0.1	71.6	0.01
9	65,249	65,550				<0.1	107.4	0.02
10	65,640	63,050				<0.1	140.7	0.01
11	51,266	47,030				<0.1	59.7	0.02
12	98,657	84,770				<0.1	139.2	0.00
13	64,182	54,340				<0.1	119.3	0.02
14	37,936	34,760				<0.1	19.9	0.00
15	50,595	44,590				<0.1	188.7	0.01
16	51,043	43,270	<1.8	<1.8	<1.0	<0.1	226.6	0.04
17	37,560	31,430	<1.8	<1.8	<1.0	<0.1	168.7	0.04
18	39,327	33,480				<0.1	43.8	0.04
19	82,555	60,570				<0.1	171.1	0.00
20	53,585	39,200				<0.1	78.7	0.02
21	56,659	46,540					171.1	0.02
22	53,316	37,970	2.0	<1.8	<1.0	<0.1	99.5	0.01
23	63,182	44,580				<0.1	139.2	0.01
24	52,817	41,330				<0.1	57.6	0.00
25	41,578	32,980				<0.1	112.8	0.01
26	49,734	33,340				<0.1	123.3	0.01
27	72,779	49,590					163.1	0.02
28	56,530	35,860					159.1	0.01
29	41,713	41,980					165.5	0.02
30								
31								
Min	37,560	31,430	<1.8	<1.8	<1.0	<0.1	19.9	0.00
Mean	59,369.8	52,577.6	<1.8	<1.8	<1.0	<0.1	128.8	0.02
Max	98,657	88,670	2.0	<1.8	1.0	<0.1	226.6	0.04
Total	1,721,725	1,524,750	Effluent average dry weather flow NTE a monthly average of 0.2 MGD.					

### Effluent and Influent Monitoring

Date	Monthly Effluent BOD (24 HC)	Monthly Effluent TSS (24 HC)	Monthly Influent BOD (24 HC)	Monthly Influent TSS (24 HC)
4/21/26				
BOD Removal:		TSS Removal:		

### Effluent Monitoring

Date	Weekly Dissolved Oxygen (Grab)	Weekly Turbidity (Grab)	Weekly pH (Grab)	Weekly Temp °F (Grab)
4/6/26	6.0	1.4	6.82	73.6
4/16/26	6.5	1.5	6.94	69.7
4/21/26				
4/28/26				
Min	6.0	1.4	6.82	69.7
Mean	6.3	1.5	6.88	71.7
Max	6.5	1.5	6.94	73.6

### Sludge Removal

Date	Gallons
N/A	N/A

### Influent Brine Received

Date	Gallons
N/A	N/A

### Semi-Annual Effluent Oil & Grease

Date	Result (mg/L)
1/20/26	<5.0
July	---

### Effluent Limits

Parameter	Units	Monthly Avg	Weekly Avg	Daily Max
BOD	mg/L	30	45	90
Suspended Solids	mg/L	30	45	90
Oil and Grease	mg/L	25	40	75
Turbidity	NTU	75	100	225
Total Coliform	MPN/100 mL	30 Day Geometric Mean: 230		
		Daily Maximum: 2,400		
Chlorine Residual	mg/L	6 Month Median: 0.23		0.93
		Instantaneous Maximum: 6.9		
pH	pH units	Between 6.0 - 9.0		
Settleable Solids	mL/L	1.0	1.5	3.0
BOD/TSS Removal	%	≥ 85%	***	***

I certify under penalty of perjury that the foregoing is true and accurate and that the sampling procedure and analysis used are as specified in the Waste Discharge Order for this facility.

SIGNATURE: \_\_\_\_\_

DATE: \_\_\_\_\_

PRINTED NAME: \_\_\_\_\_


TITLE: \_\_\_\_\_

## SAN SIMEON CSD AVERAGE DAILY EFFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
<b>EFFLUENT DRY WEATHER AVERAGE DAILY FLOW LIMIT</b>	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000
<b>2024</b>	69,123	108,920	79,757	74,812	63,117	68,885	76,021	70,269	62,465	53,768	53,148	58,262
<b>2025</b>	44,231	64,372	60,786	63,575	55,226	46,911	57,893	36,023	51,005	42,481	57,625	51,907
<b>2026</b>	62,468	68,708	52,826	52,578								

## SSCSD AVERAGE DAILY WWTP EFFLUENT FLOW

■ 2024   
 ■ 2025   
 ■ 2026   
 — Permit Limit

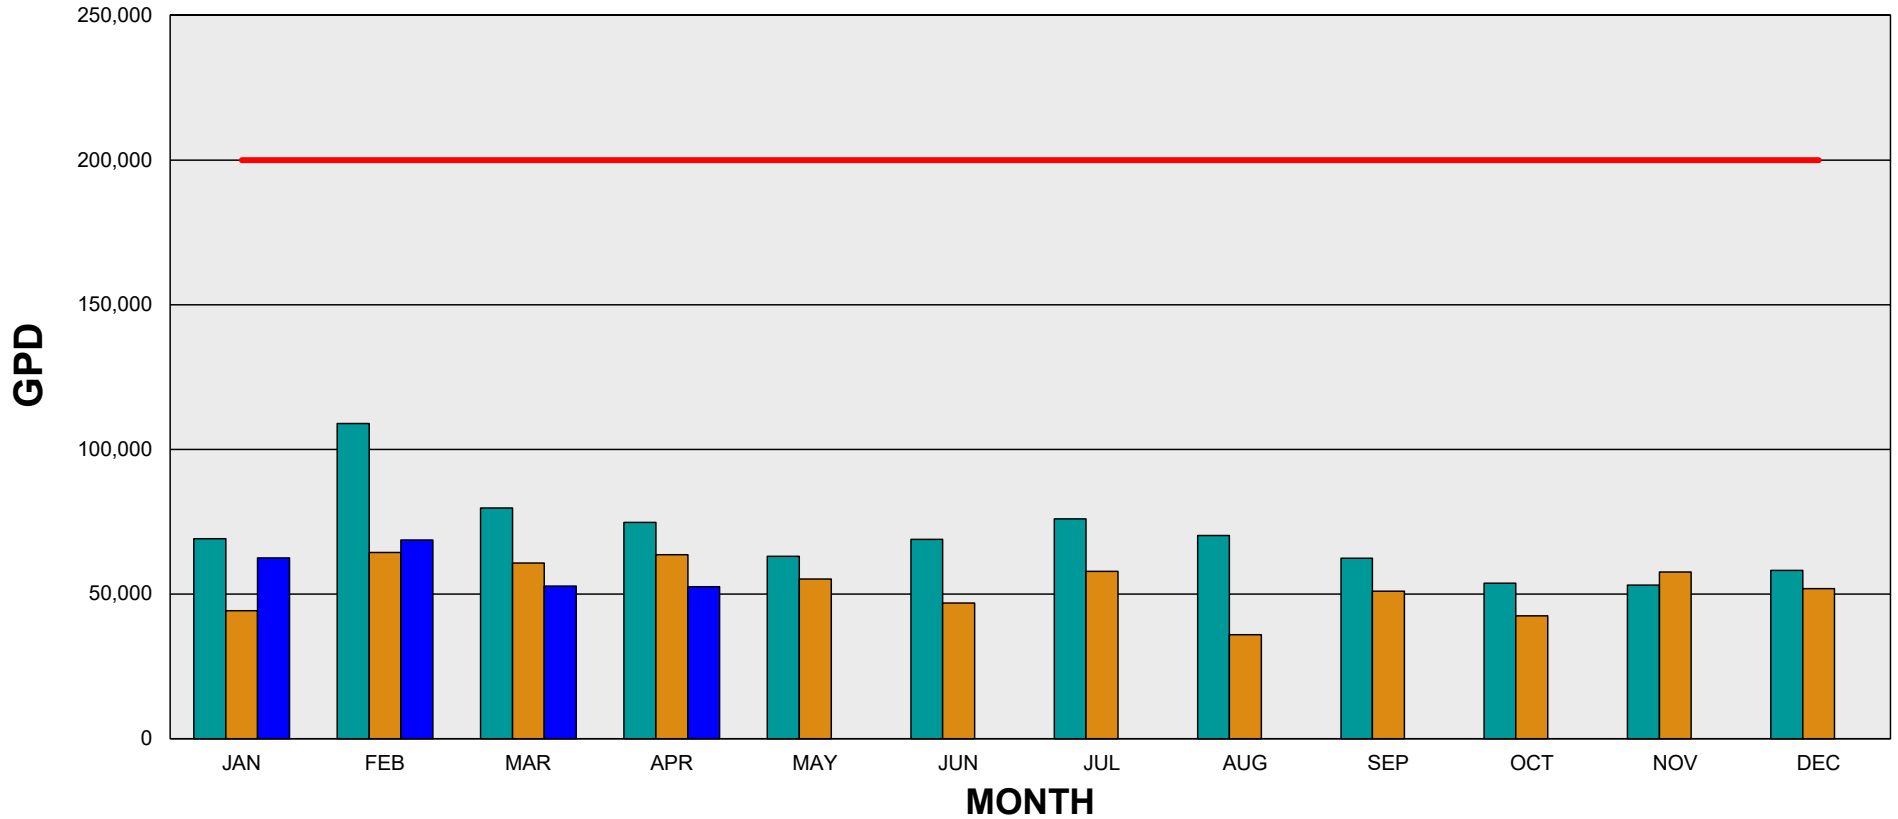


*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD MONTHLY TOTAL EFFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	1,936,510	1,923,820	1,637,620	1,524,750								

## SSCSD MONTHLY TOTAL WWTP EFFLUENT FLOW

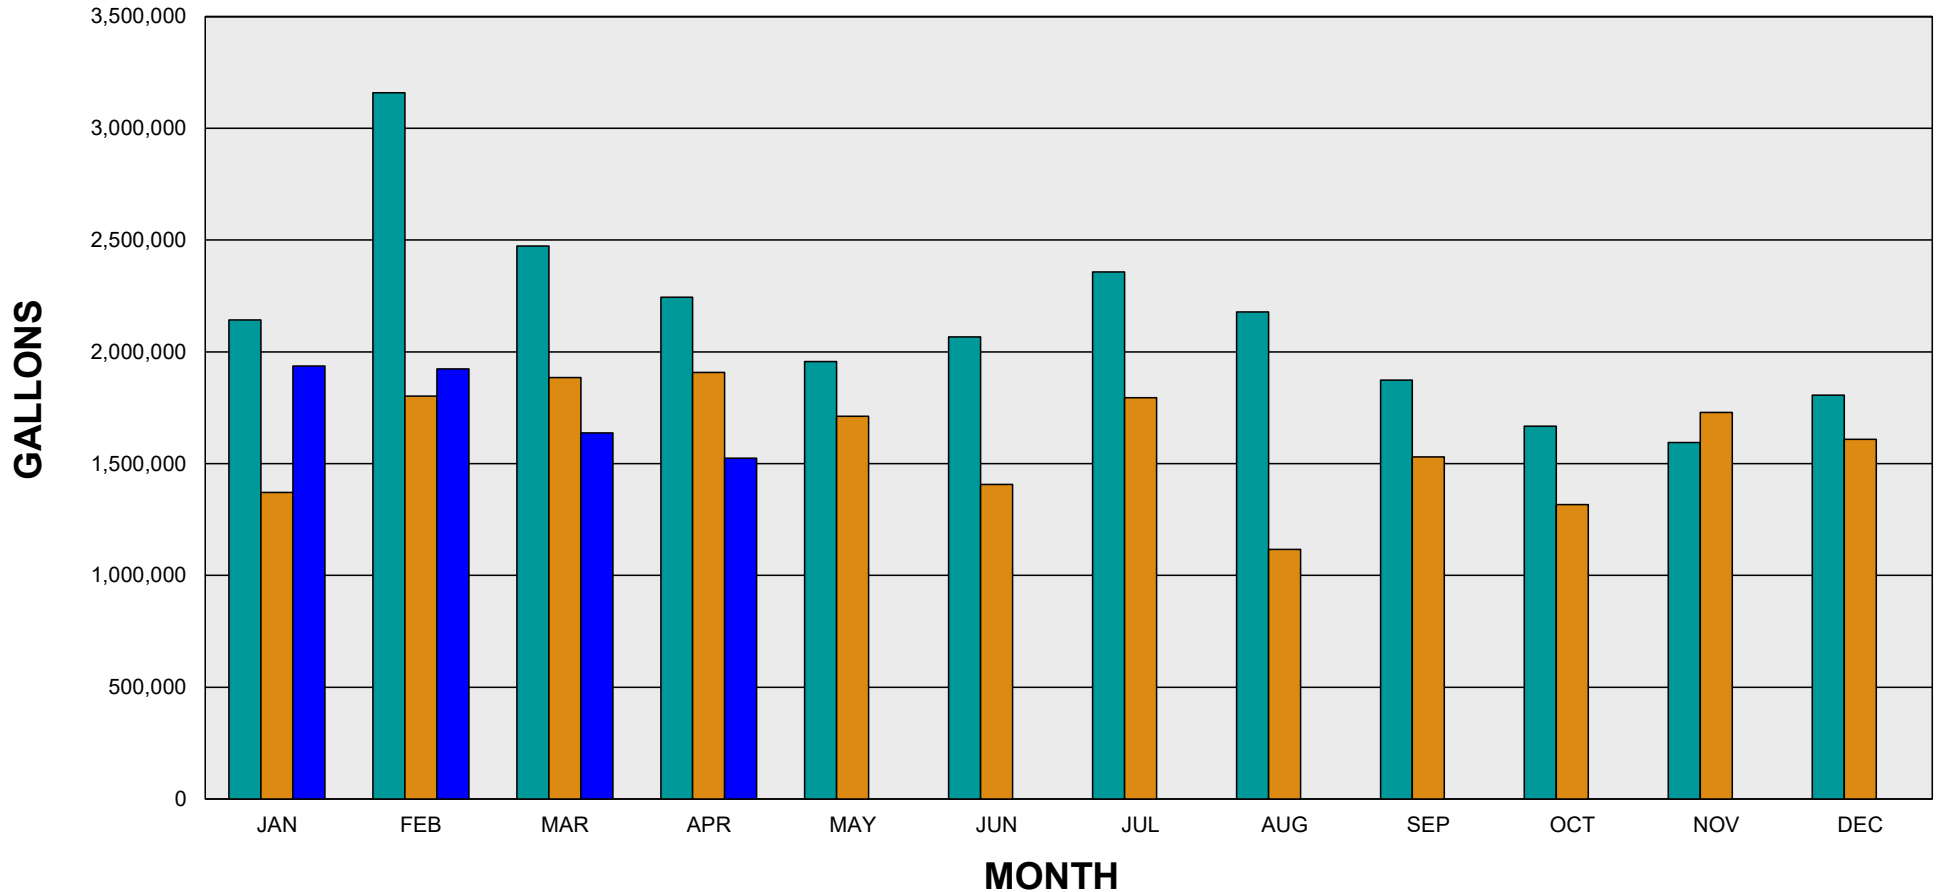


*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD AVERAGE DAILY INFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	73,426	115,645	81,673	76,105	61,541	67,958	75,673	70,547	61,328	51,160	48,404	57,507
2025	42,268	61,220	58,891	56,049	55,635	61,765	69,394	62,696	60,055	54,337	60,496	56,579
2026	69,567	72,076	58,727	59,370								

## SSCSD AVERAGE DAILY WWTP INFLUENT FLOW

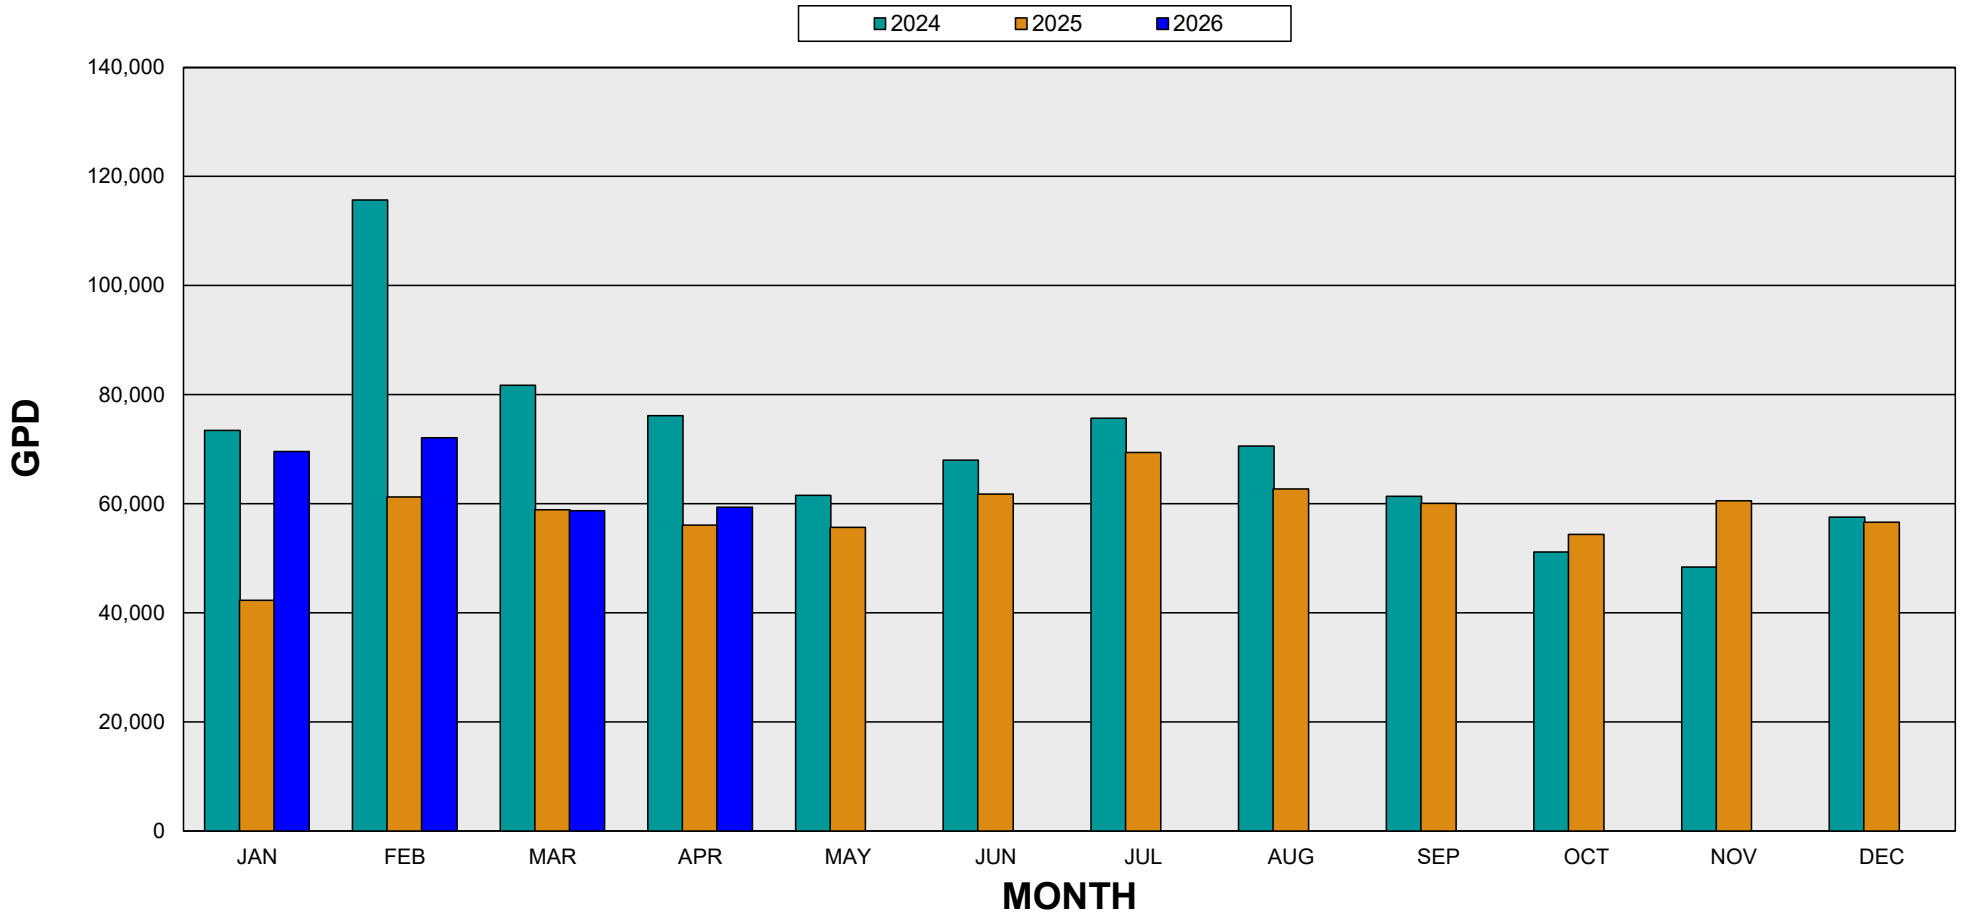


*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD MONTHLY TOTAL INFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,276,191	3,353,693	2,531,854	2,283,155	1,907,760	2,038,747	2,345,876	2,186,946	1,839,831	1,633,973	1,534,789	1,782,722
2025	1,310,305	1,714,171	1,825,606	1,681,465	1,724,693	1,852,964	2,151,214	1,943,565	1,801,654	1,684,454	1,814,894	1,753,949
2026	2,156,572	2,018,115	1,820,537	1,721,725								


## SSCSD MONTHLY TOTAL WWTP INFLUENT FLOW

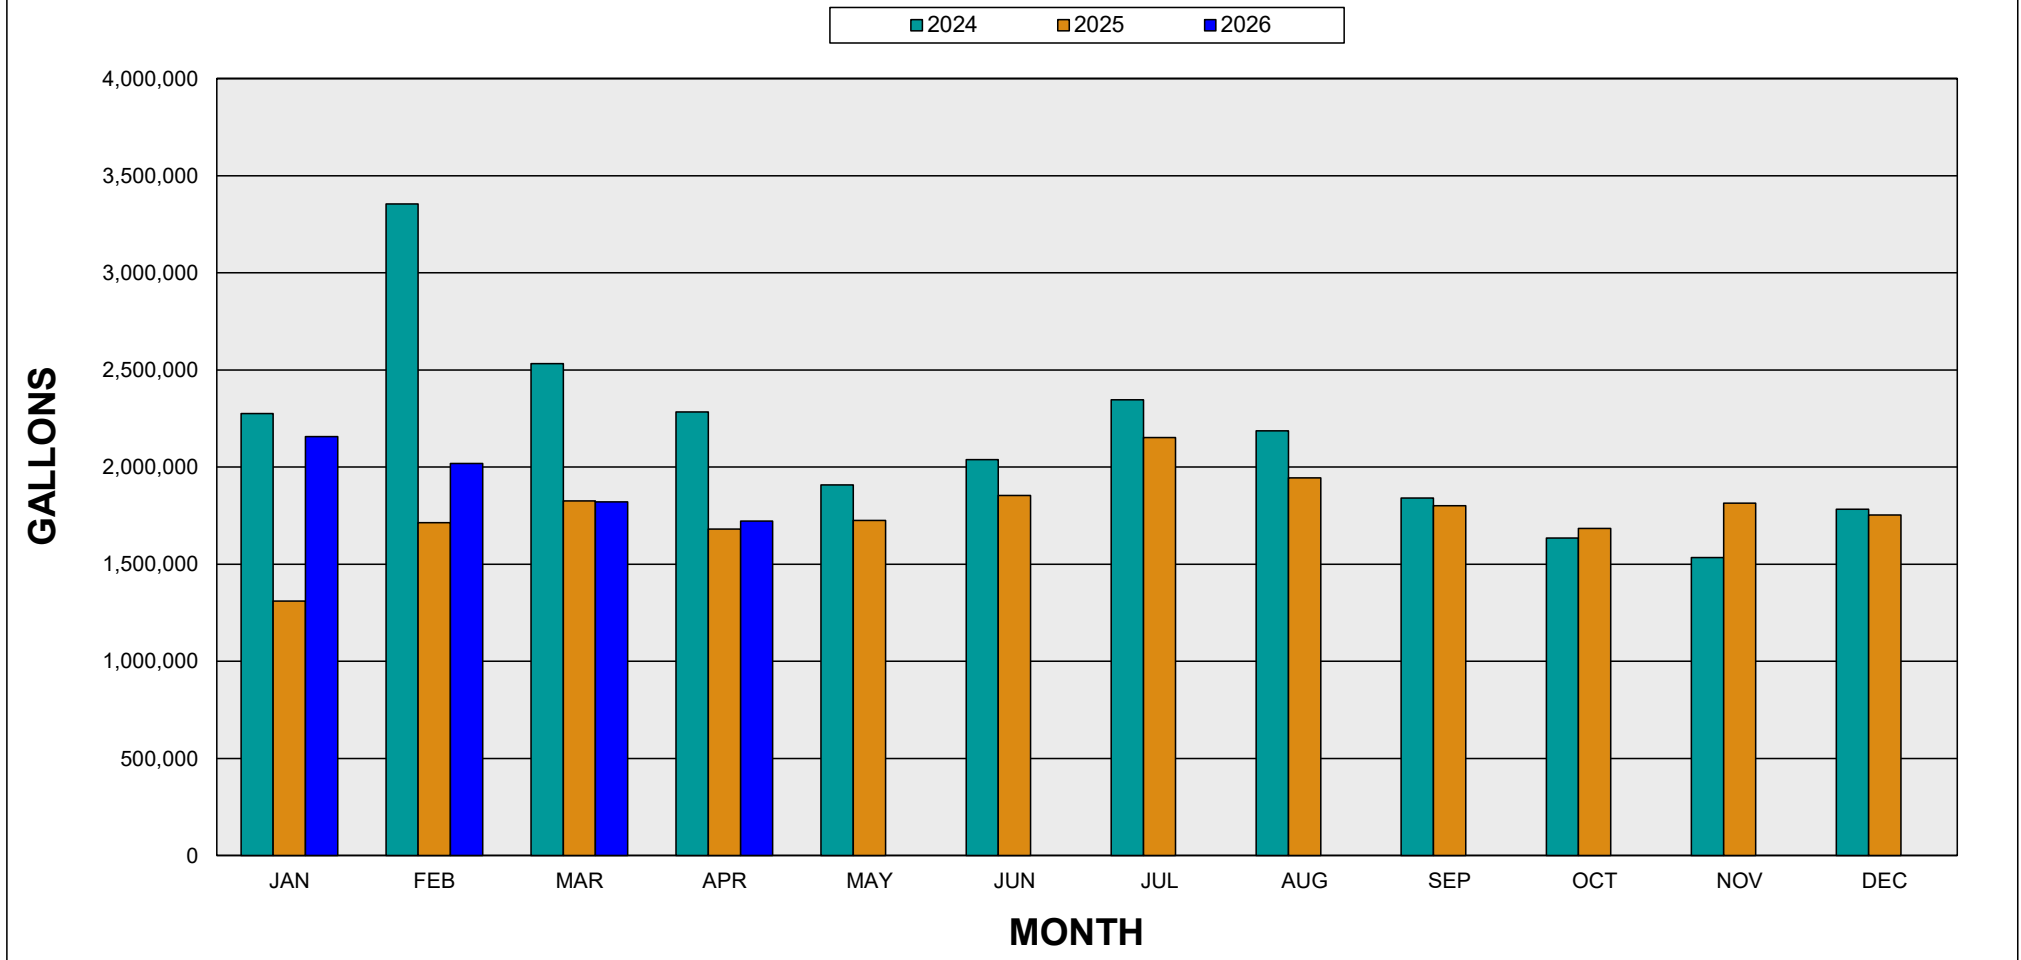

*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD TREATED WATER PRODUCED (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,776,950
2025	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
2026	1,679,335	1,789,216	2,029,698	1,993,944								

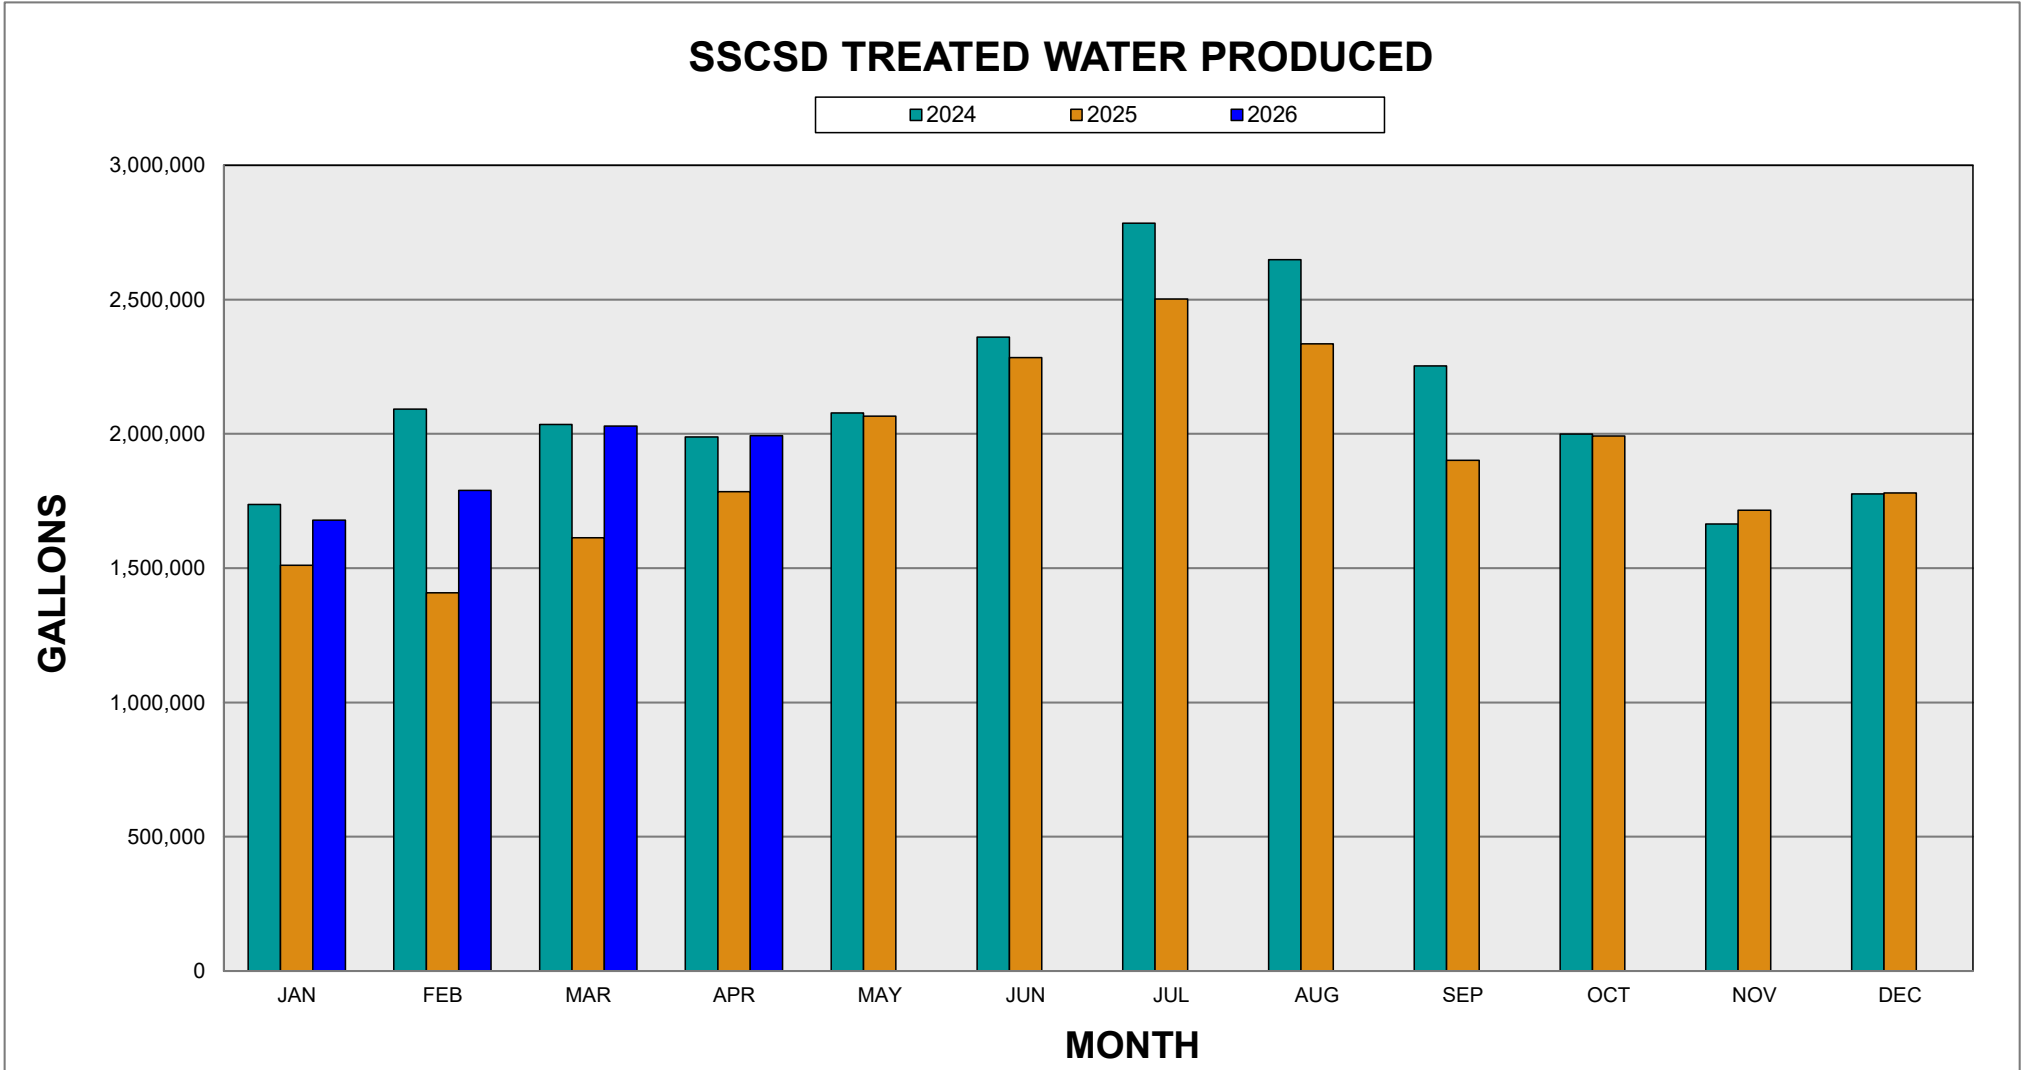


*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD TOTAL WATER SOLD (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,333,721	1,793,929	1,861,122	1,437,461	1,985,933	1,852,901	2,368,923	2,297,550	1,957,965	2,021,356	1,664,674	1,504,729
2025	1,615,807	1,393,330	1,487,809	1,584,795	1,914,865	1,767,733	2,811,321	2,153,470	1,701,992	1,672,835	1,220,856	1,850,141
2026	1,352,339	1,381,122	1,592,941									

### SSCSD TOTAL WATER SOLD


■ 2024   
 ■ 2025   
 ■ 2026

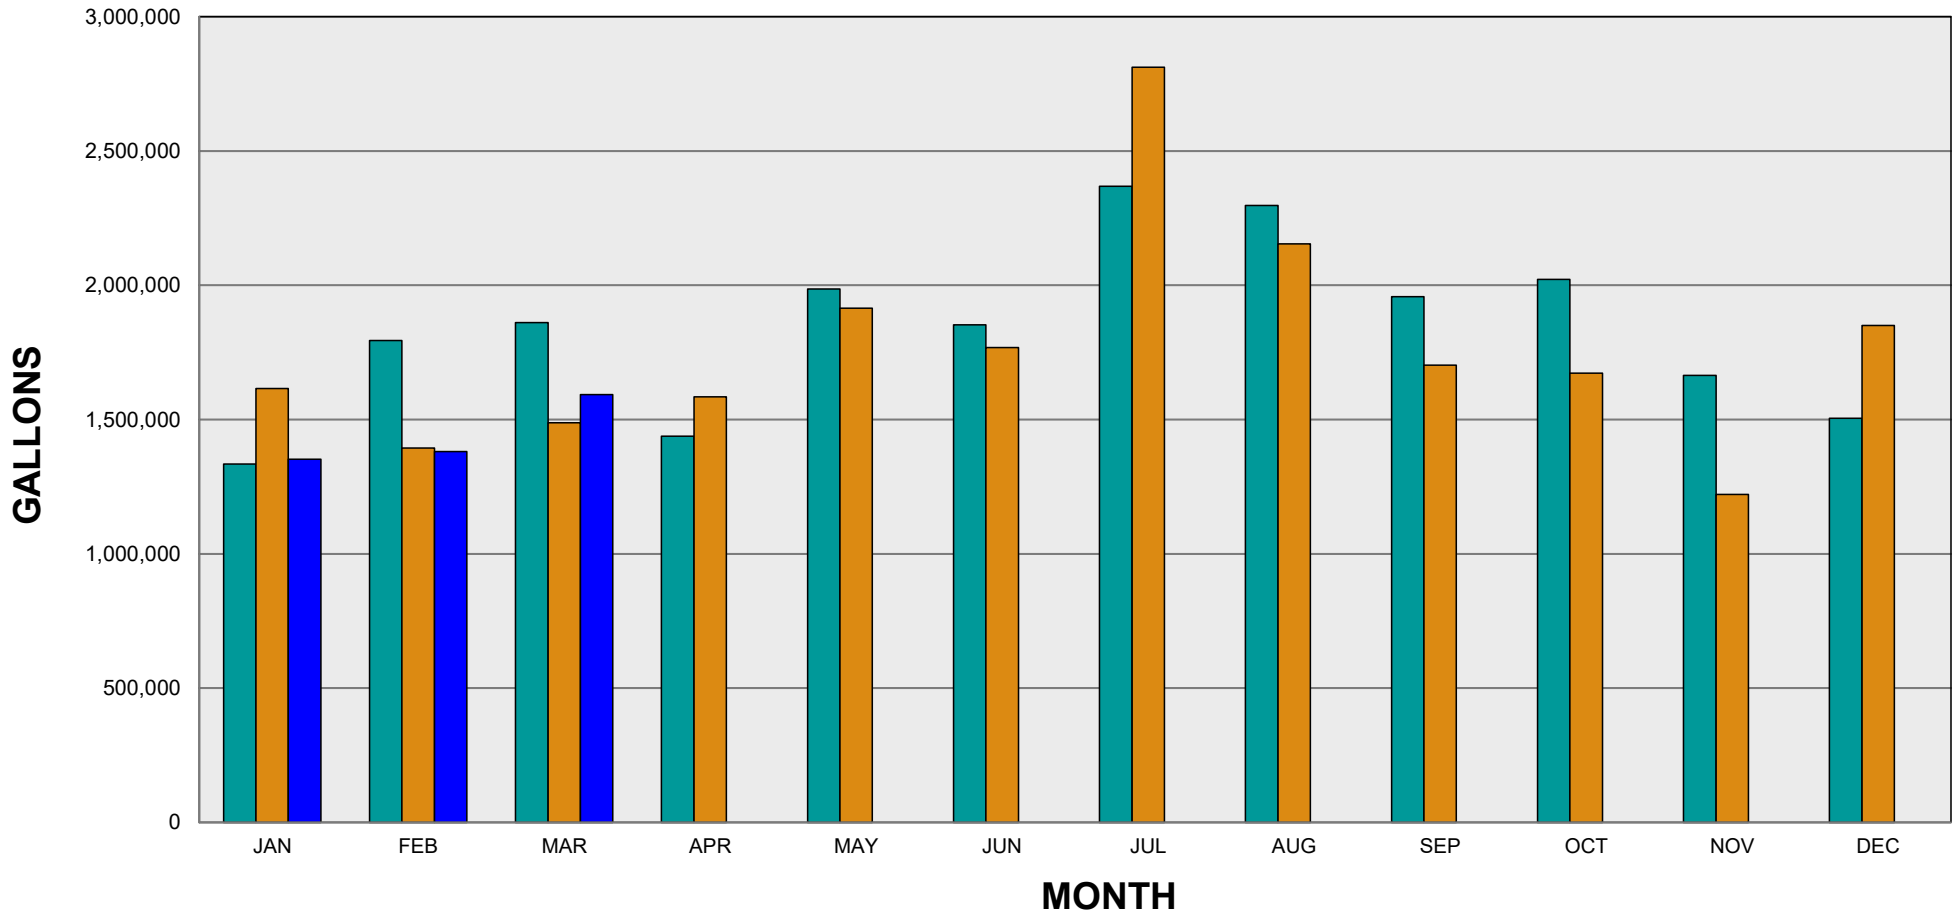

*Data for this report is current up to 4/30, and is subject to change for future reporting.*

# SAN SIMEON CSD WASTEWATER TREATMENT PLANT WATER USED (GALLONS)



MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	---	---	---	---	---	---	---	---	---	14,519	5,887	8,932
2025	6,082	6,815	9,119	6,665	7,870	7,047	7,555	6,456	28,815	6,747	6,112	7,548
2026	5,558	5,461	8,655	6,321								

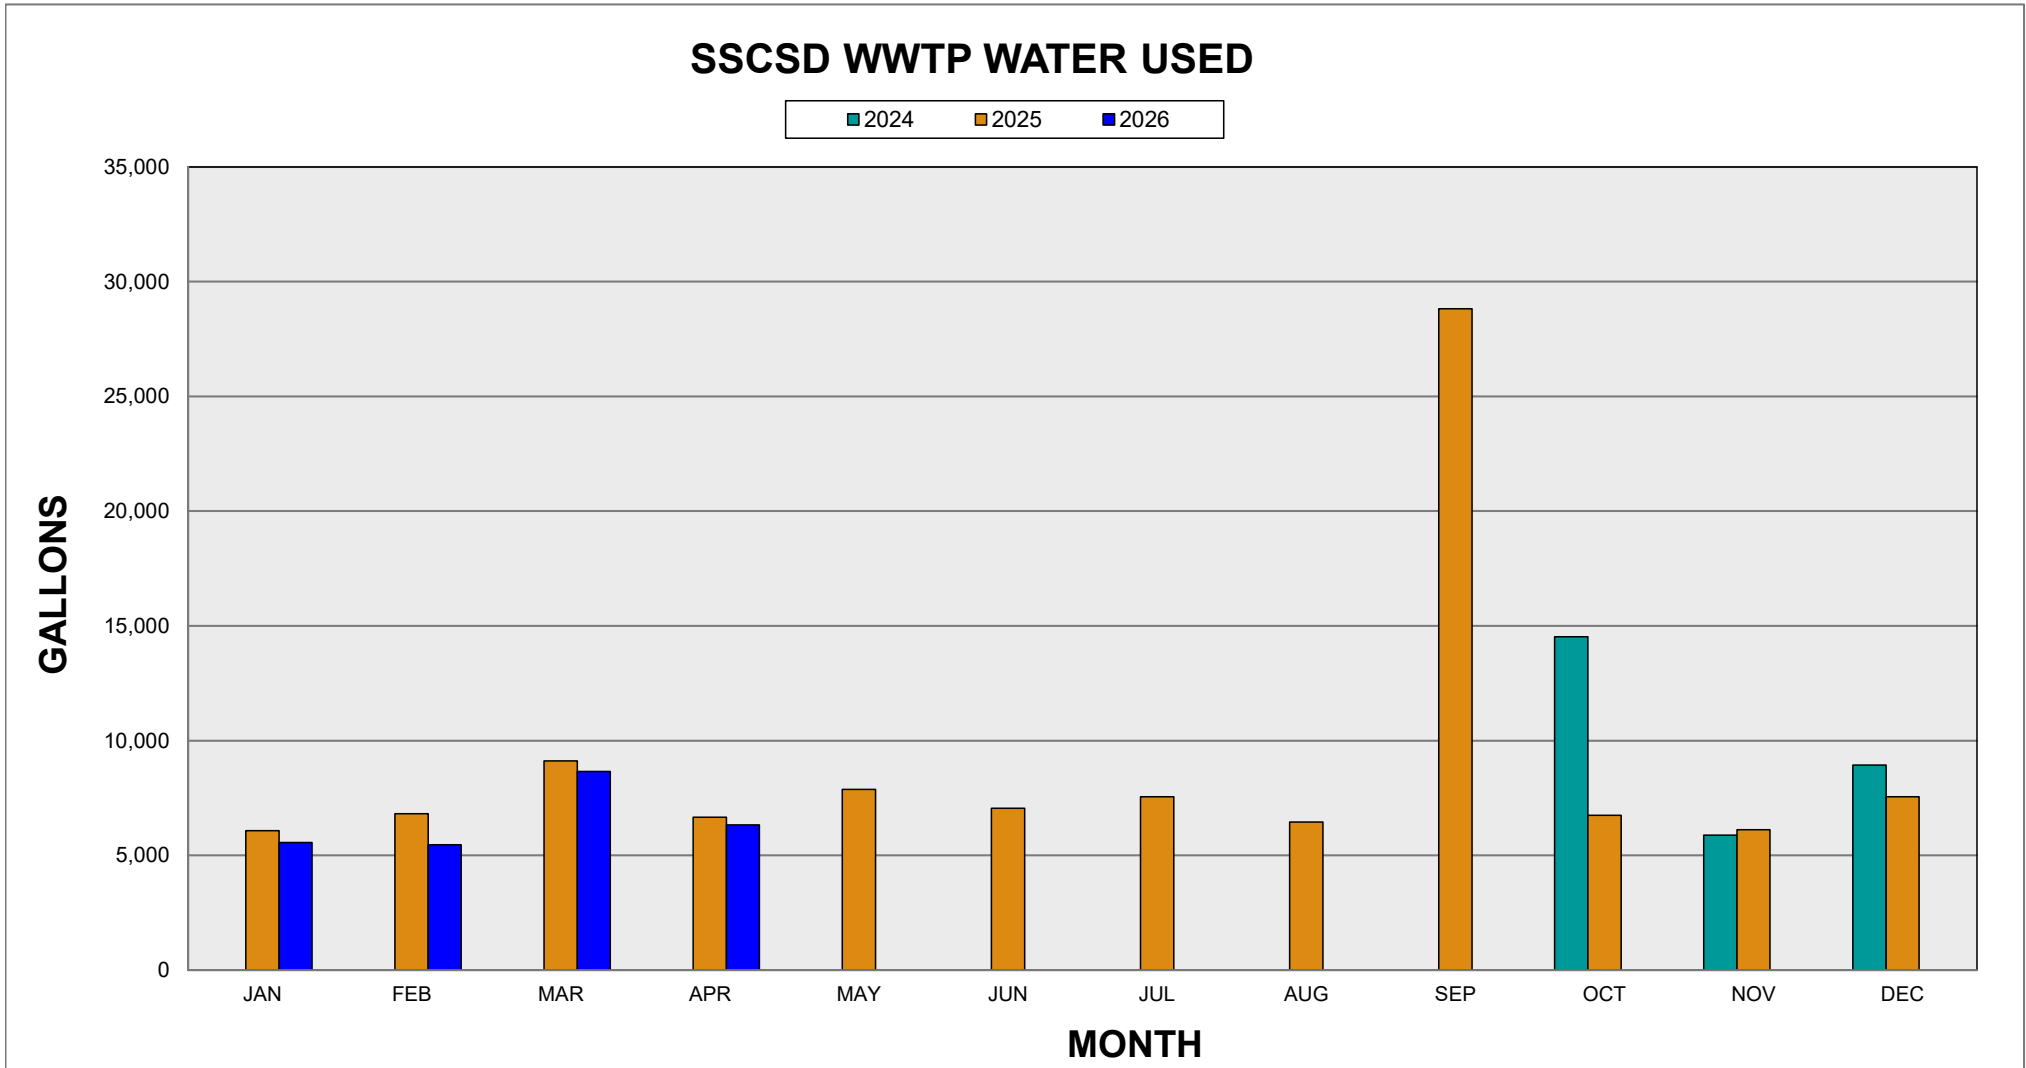

*Data for this report is current up to 4/30, and is subject to change for future reporting.*

## SAN SIMEON CSD PRODUCTION DATA (GALLONS)

2023	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	---	---	---	---	---	---	---	---	2,187,977	2,207,872	1,951,981	2,103,226
TOTAL EFFLUENT FLOW (GAL)	---	---	---	---	---	---	---	---	1,873,570	1,951,950	1,830,260	2,114,900
2024	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,845,466
TOTAL EFFLUENT FLOW (GAL)	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
TOTAL EFFLUENT FLOW (GAL)	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,679,335	1,789,216	2,029,698	1,993,944								
TOTAL EFFLUENT FLOW (GAL)	1,936,510	1,923,820	1,637,620	1,524,750								

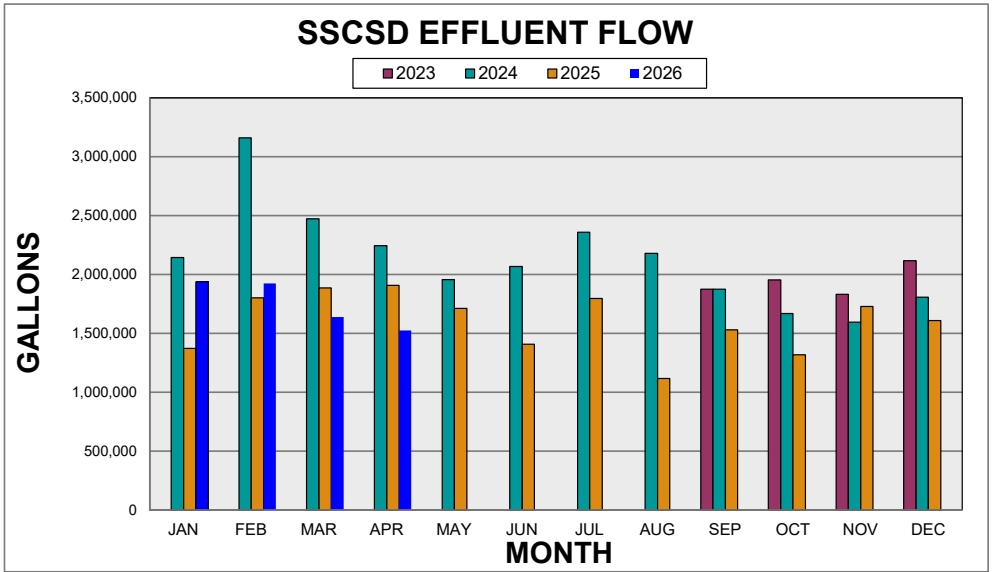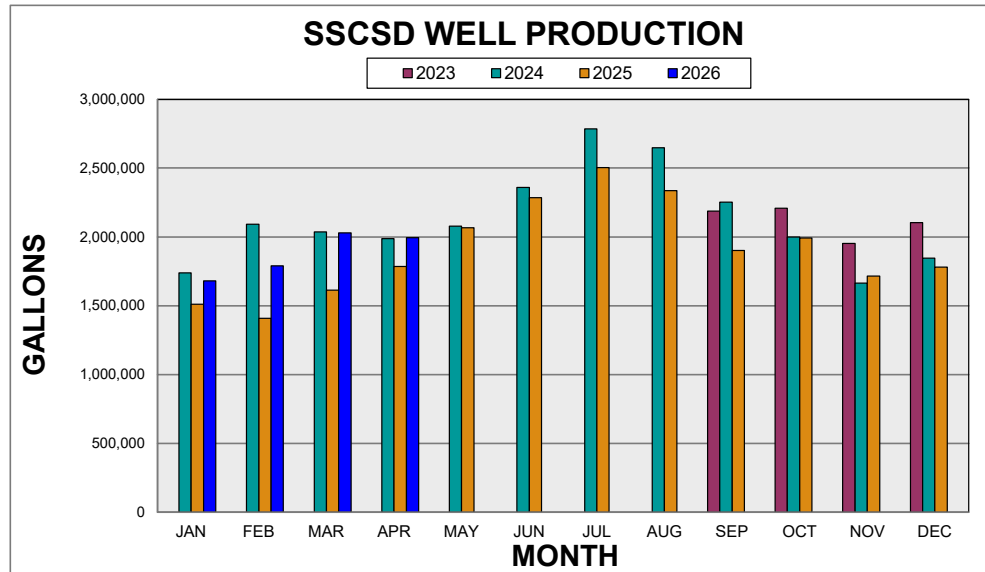

Data for this report is current up to 4/30, and is subject to change for future reporting.