



January 31, 2026

San Simeon Community Services District
111 Pico Avenue
San Simeon, CA 93452

SUBJECT: JANUARY 2026 MONTHLY FACILITY REPORT FOR THE SAN SIMEON COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT PLANT, WATER SYSTEM, AND COLLECTION SYSTEM

WASTEWATER TREATMENT PLANT

On January 11th, the Auto system had shut off for the blower house lift station near San Simeon Creek Campground. Staff found that water in the conduit was causing connection issues with the back-up floats, which had been caught up in the pumps. Staff resolved the issue by re-splicing all three floats, relocating cabinet entry points, and testing the system. Proper operation was confirmed and the system was returned to Auto the same day.

WATER SYSTEM

Due to failures of several mechanical components, the Cla Val for Well 2 was repaired, and the Cla Val for Well 1 was rebuilt.

The water storage tank was inspected and cleaned on January 22nd. The tank inspection was a regulatory requirement from the 2025 Sanitary Survey. Following the inspection, a bacteriological sample was collected from the distribution system, and results were Non-Detect for all coliforms.

COMPLIANCE

On January 19th, an updated permit for the water system was received from State Water Resources Control Board (SWRCB) staff. FRM staff have reviewed the updated permit and are waiting on clarifications from SWRCB staff.

Staff compiled the data to complete the monthly Self-Monitoring Report and Discharge Monitoring Report in California Integrated Water Quality System (CIWQS). Once approved, the reports are uploaded into CIWQS and certified by SSCSD Staff.

Sincerely,
FLUID RESOURCE MANAGEMENT



San Simeon CSD Wastewater Treatment Facility

Monthly report due first day of second month
following monitoring period

Month: **JANUARY 2026**

Annual report due January 30

Date	Influent Flow Total (GPD)	Effluent Flow Total (GPD)	Effluent Monitoring					
			Biweekly Total Coliform	Biweekly Fecal Coliform	Biweekly Enterococcus	Daily Settleable Solids (mL/L)	Daily Chlorine Used (lbs)	Daily Chlorine Residual (mg/L)
1	84,859	75,180				<0.1	79.6	0.01
2	101,448	90,510				<0.1	119.3	0.03
3	105,295	89,240				<0.1	99.5	0.03
4	164,807	151,820				<0.1	139.2	0.02
5	121,674	103,540				<0.1	91.5	0.00
6	175,389	149,160				<0.1	176.5	0.07
7	94,967	79,370	<1.8	<1.8	<1.0	<0.1	119.3	0.05
8	74,290	61,920	<1.8	<1.8	<1.0	<0.1	123.3	0.03
9	72,706	58,310				<0.1	80.5	0.05
10	62,883	50,330				<0.1	100.2	0.03
11	73,650	58,400				<0.1	167.1	0.02
12	62,999	53,450				<0.1	152.6	0.04
13	60,078	47,450	<1.8	<1.8	<1.0	<0.1	125.1	0.04
14	47,293	38,870	<1.8	<1.8	<1.0	<0.1	135.3	0.05
15	45,348	39,020				<0.1	101.8	0.03
16	44,289	38,750				<0.1	136.8	0.04
17	46,554	37,710				<0.1	91.5	0.00
18	70,086	57,130				<0.1	179.0	0.04
19	72,535	57,110				<0.1	95.5	0.04
20	76,244	62,220	2.0	<1.8	<1.0	<0.1	130.5	0.02
21	39,491	40,010	<1.8	<1.8	<1.0	<0.1	115.4	0.01
22	40,161	41,690				<0.1	90.7	0.04
23	43,047	45,670				<0.1	119.3	0.04
24	45,298	40,930				<0.1	95.5	0.00
25	60,996	49,950				<0.1	147.2	0.03
26	50,939	45,850				<0.1	103.4	0.01
27	50,070	56,990	3.7	2.0	<1.0	<0.1	190.9	0.01
28	38,558	50,730	2.0	<1.8	<1.0	<0.1	86.7	0.00
29	42,100	56,010				<0.1	178.6	0.01
30	48,877	60,250				<0.1	113.0	0.01
31	39,641	48,940				<0.1	47.74	0.01
Min	38,558	37,710	<1.8	<1.8	<1.0	<0.1	47.7	0.00
Mean	69,566.8	62,468.1	<1.8	<1.8	<1.0	<0.1	120.4	0.03
Max	175,389	151,820	3.7	<1.8	<1.0	<0.1	190.9	0.07
Total	2,156,572	1,936,510						

Effluent average dry weather flow NTE a monthly average of 0.2 MGD.

Effluent and Influent Monitoring

Date	Monthly Effluent BOD (24 HC)	Monthly Effluent TSS (24 HC)	Monthly Influent BOD (24 HC)	Monthly Influent TSS (24 HC)
1/20/26	<4.0	8.8	240	130
BOD Removal: 100.0%		TSS Removal: 93.2%		

Effluent Monitoring

Date	Weekly Dissolved Oxygen (Grab)	Weekly Turbidity (Grab)	Weekly pH (Grab)	Weekly Temp °F (Grab)
1/8/26	6.9	3.5	7.23	63.8
1/13/26	6.7	2.3	6.85	63.1
1/20/26	5.3	2.9	6.87	66.8
1/27/26	3.6	6.0	6.63	64.7
Min	3.6	2.3	6.63	63.1
Mean	5.6	3.7	6.90	64.6
Max	6.9	6.0	7.23	66.8

Sludge Removal

Date	Gallons
1/12/26	4,800

Influent Brine Received

Date	Gallons
N/A	N/A

Semi-Annual Effluent Oil & Grease

Date	Result (mg/L)
1/20/26	<5.0
July	---

Effluent Limits

Parameter	Units	Monthly Avg	Weekly Avg	Daily Max
BOD	mg/L	30	45	90
Suspended Solids	mg/L	30	45	90
Oil and Grease	mg/L	25	40	75
Turbidity	NTU	75	100	225
Total Coliform	MPN/100 mL	30 Day Geometric Mean: 230		
		Daily Maximum: 2,400		
Chlorine Residual	mg/L	6 Month Median: 0.23		0.93
		Instantaneous Maximum: 6.9		
pH	pH units	Between 6.0 - 9.0		
Settleable Solids	mL/L	1.0	1.5	3.0
BOD/TSS Removal	%	≥ 85%	***	***

I certify under penalty of perjury that the foregoing is true and accurate and that the sampling procedure and analysis used are as specified in the Waste Discharge Order for this facility.

SIGNATURE: _____

DATE: _____

PRINTED NAME: _____


TITLE: _____

SAN SIMEON CSD AVERAGE DAILY EFFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
EFFLUENT DRY WEATHER AVERAGE DAILY FLOW LIMIT	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000
2024	69,123	108,920	79,757	74,812	63,117	68,885	76,021	70,269	62,465	53,768	53,148	58,262
2025	44,231	64,372	60,786	63,575	55,226	46,911	57,893	36,023	51,005	42,481	57,625	51,907
2026	62,468											

SSCSD AVERAGE DAILY WWTP EFFLUENT FLOW

■ 2024
 ■ 2025
 ■ 2026
 — Permit Limit

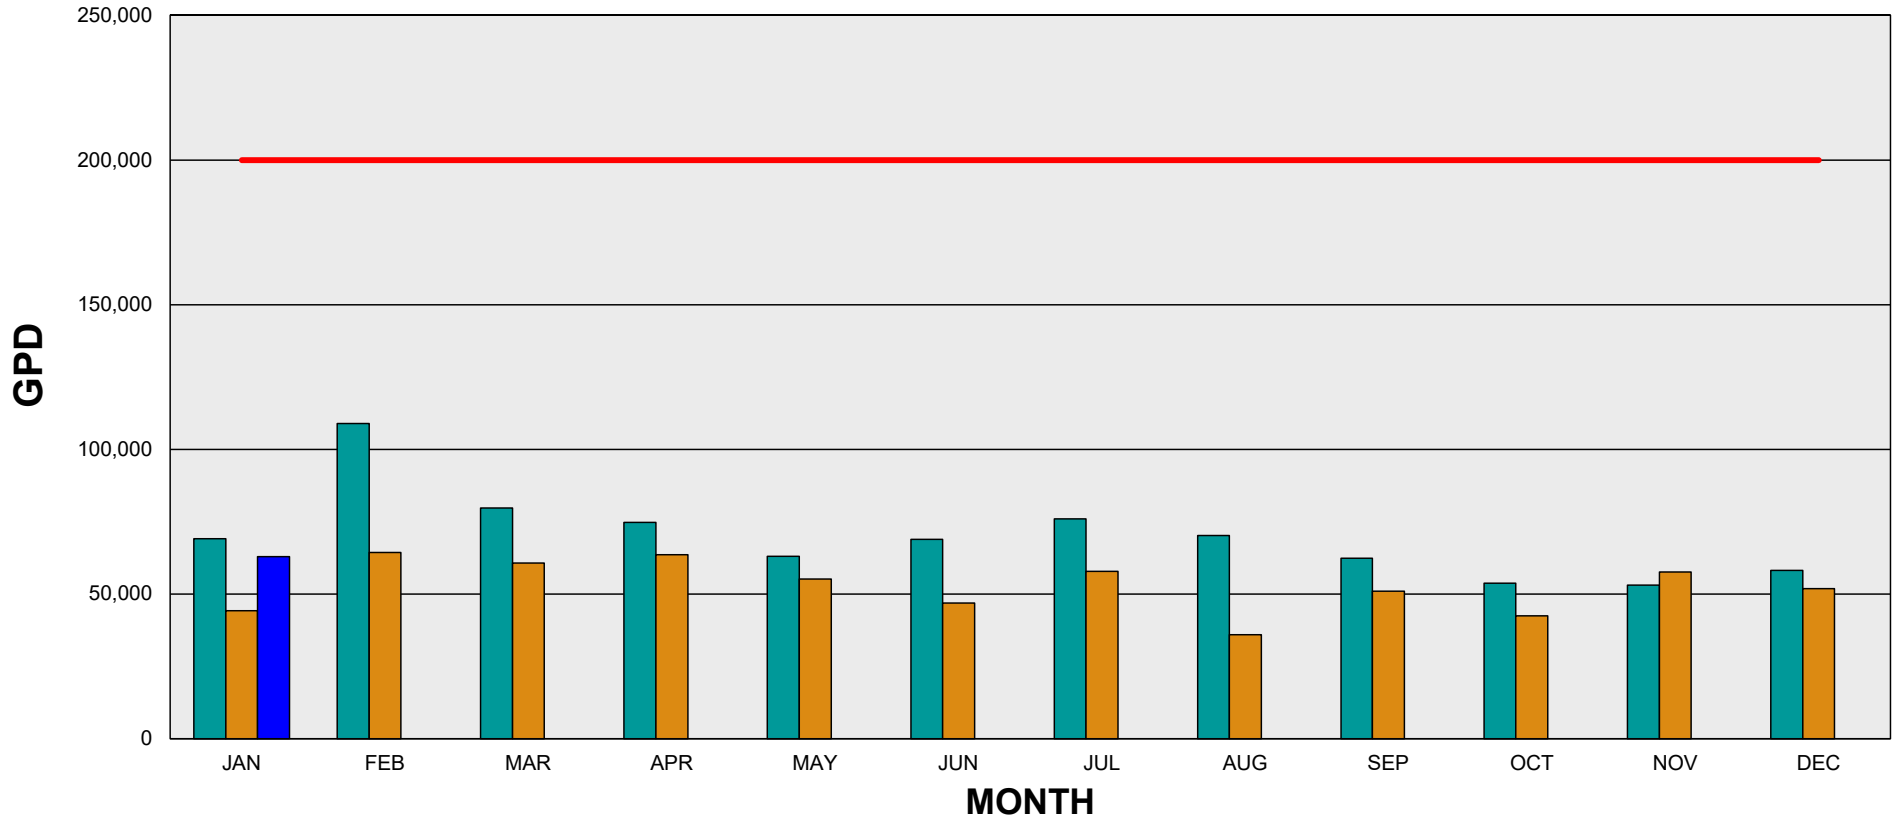


Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL EFFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	1,936,510											

SSCSD MONTHLY TOTAL WWTP EFFLUENT FLOW

■ 2024
 ■ 2025
 ■ 2026

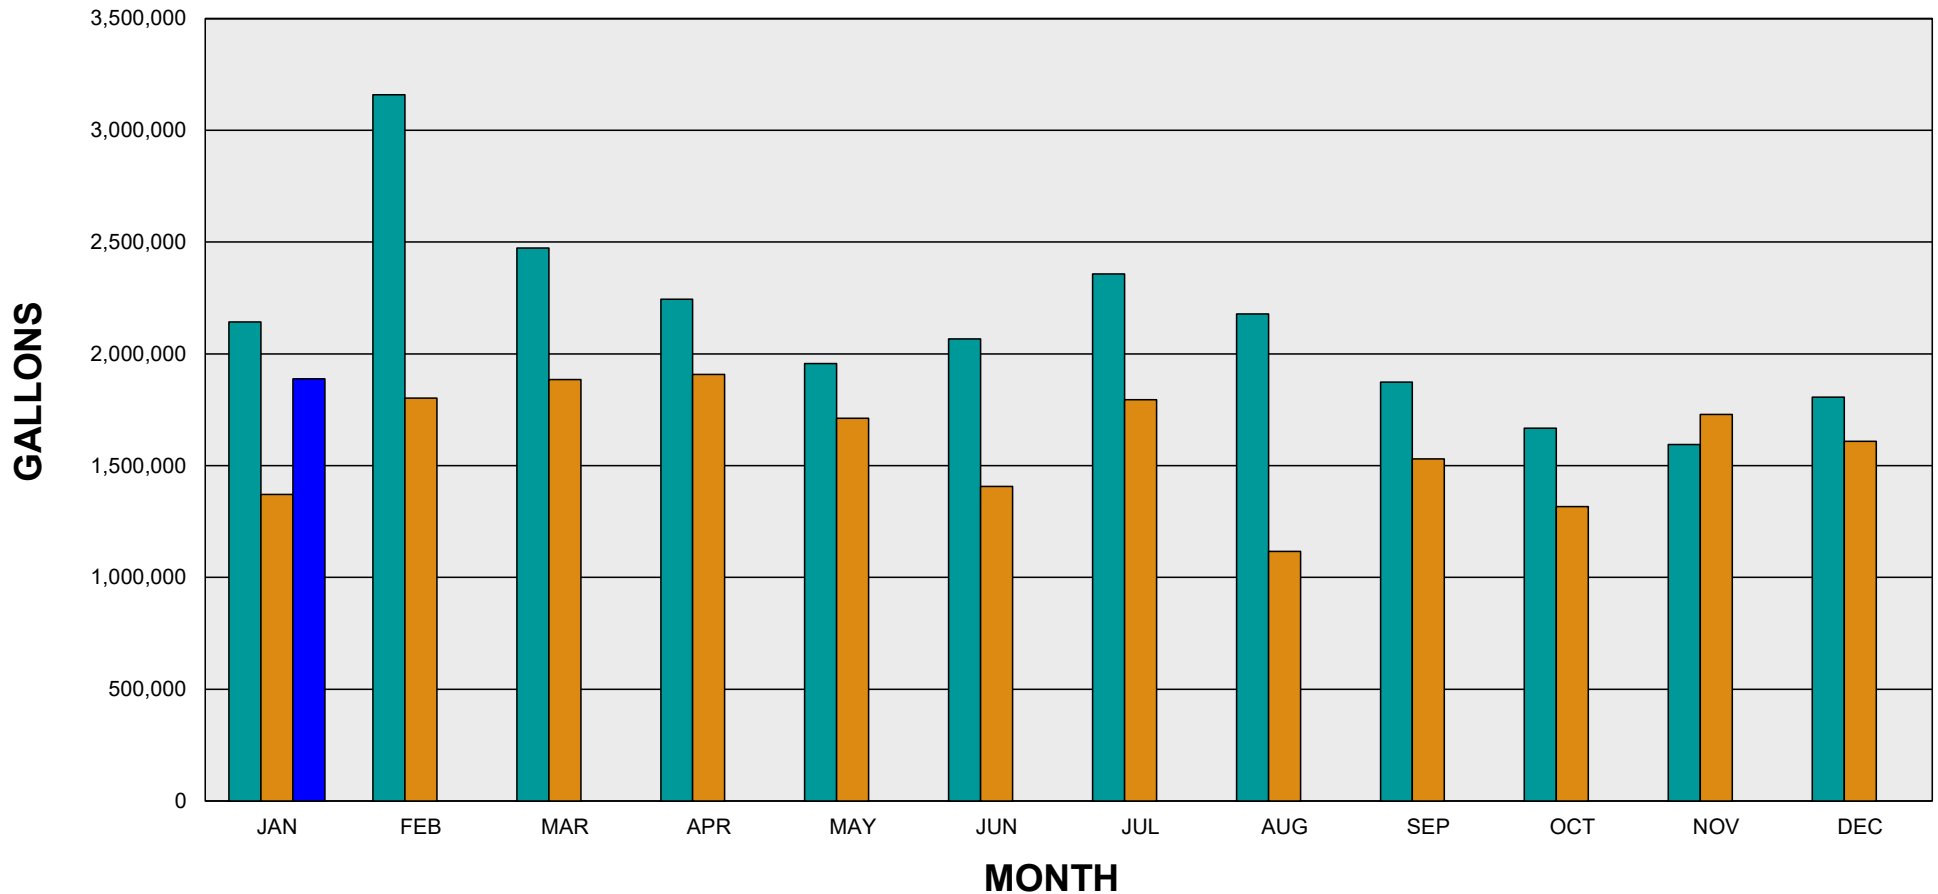


Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD AVERAGE DAILY INFLUENT FLOW (GALLONS PER DAY)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	73,426	115,645	81,673	76,105	61,541	67,958	75,673	70,547	61,328	51,160	48,404	57,507
2025	42,268	61,220	58,891	56,049	55,635	61,765	69,394	62,696	60,055	54,337	60,496	56,579
2026	69,567											

SSCSD AVERAGE DAILY WWTP INFLUENT FLOW

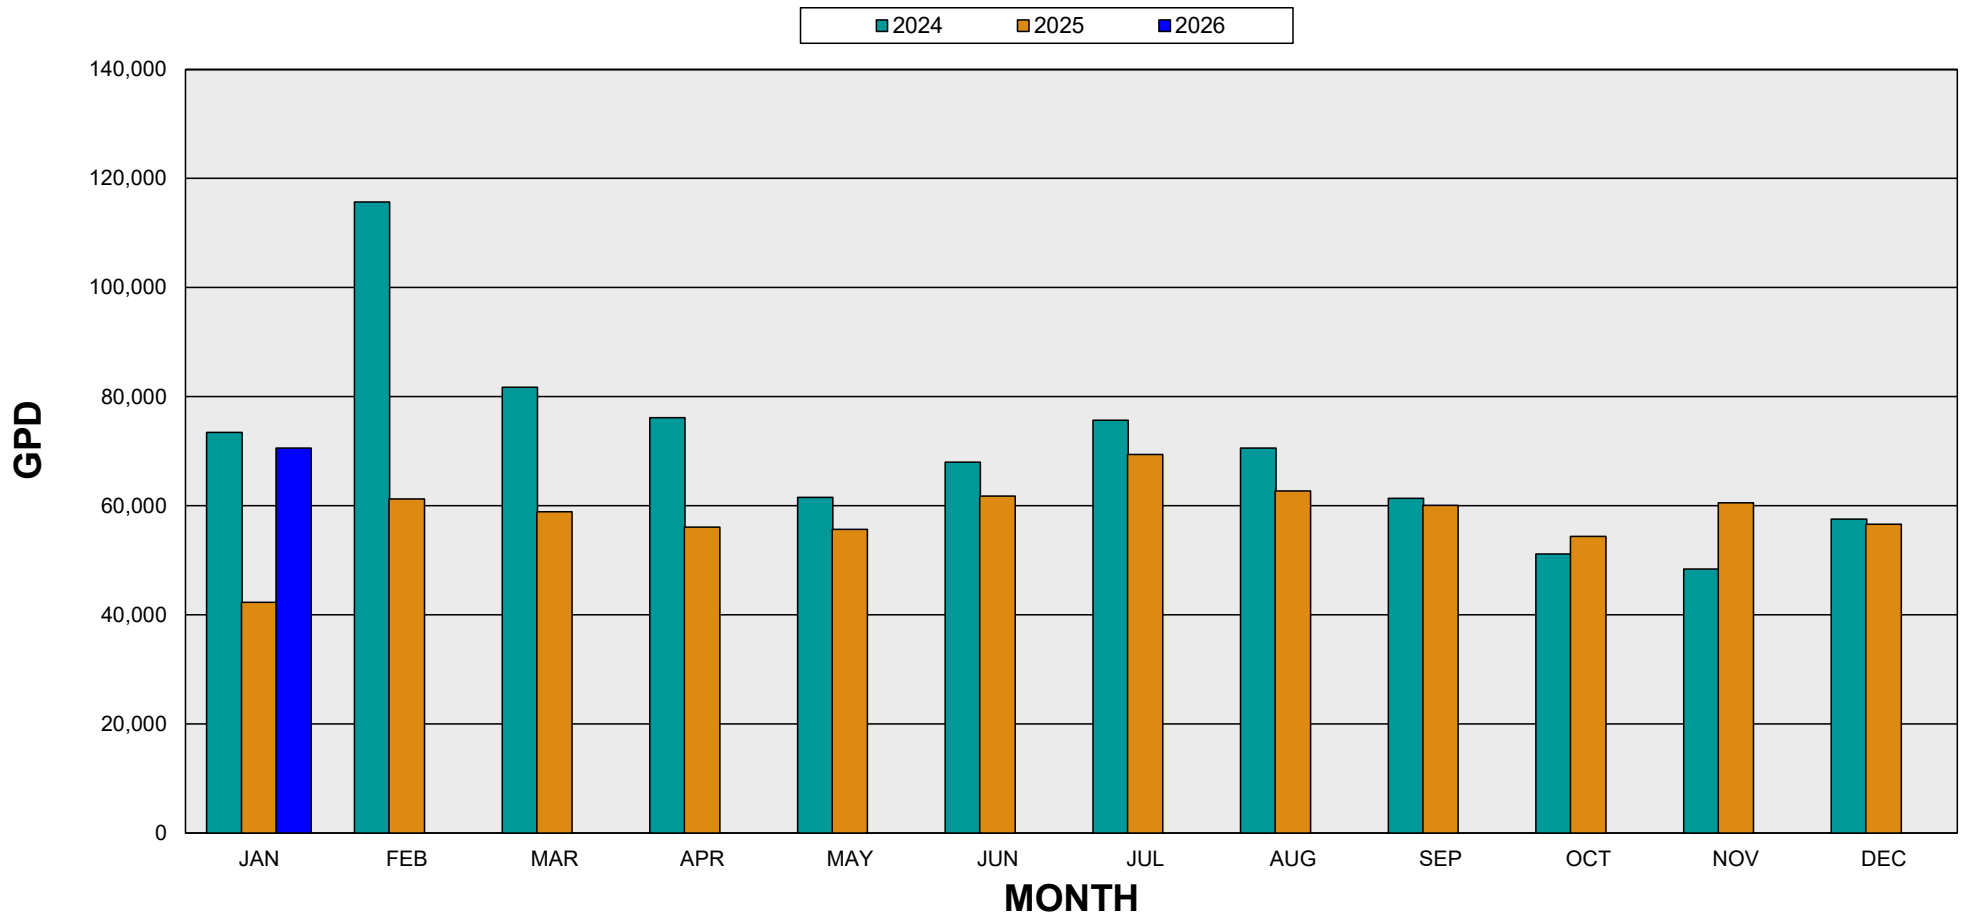


Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL INFLUENT FLOW (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,276,191	3,353,693	2,531,854	2,283,155	1,907,760	2,038,747	2,345,876	2,186,946	1,839,831	1,633,973	1,534,789	1,782,722
2025	1,310,305	1,714,171	1,825,606	1,681,465	1,724,693	1,852,964	2,151,214	1,943,565	1,801,654	1,684,454	1,814,894	1,753,949
2026	2,156,572											


SSCSD MONTHLY TOTAL WWTP INFLUENT FLOW

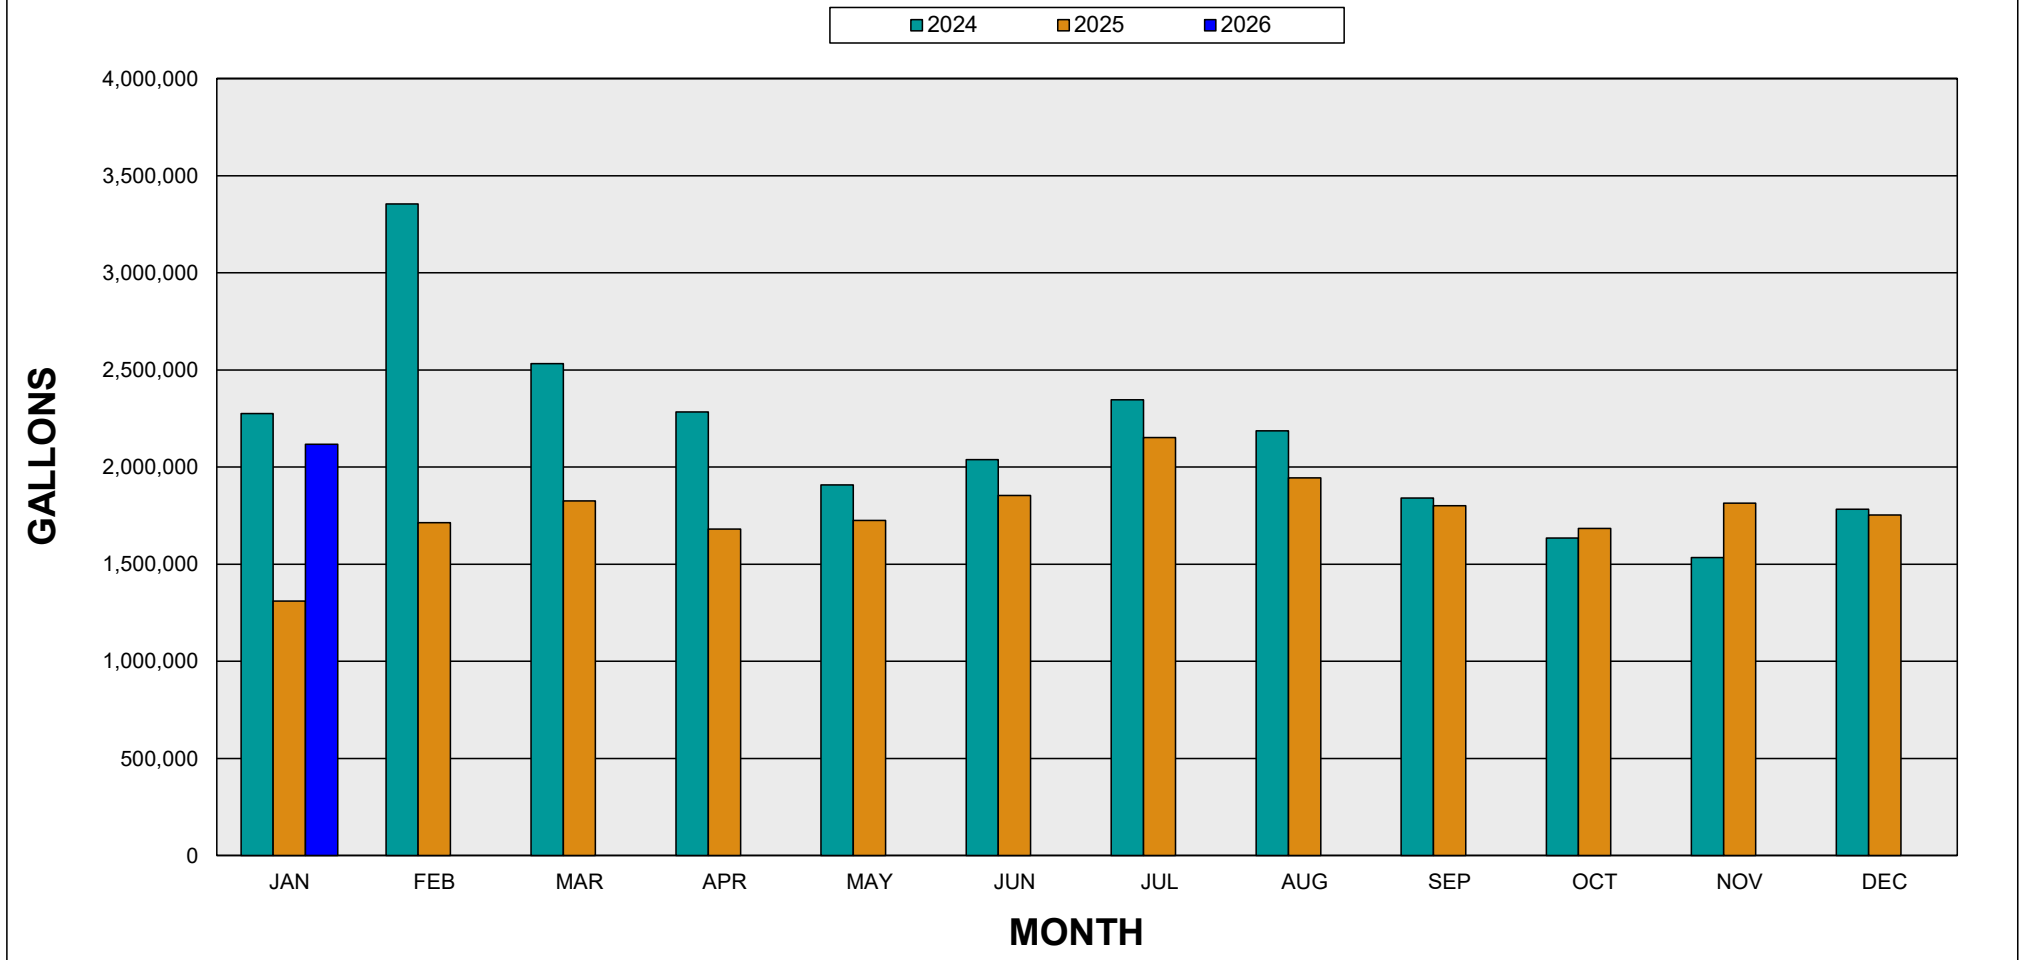

Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD TREATED WATER PRODUCED (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,776,950
2025	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
2026	1,695,978											

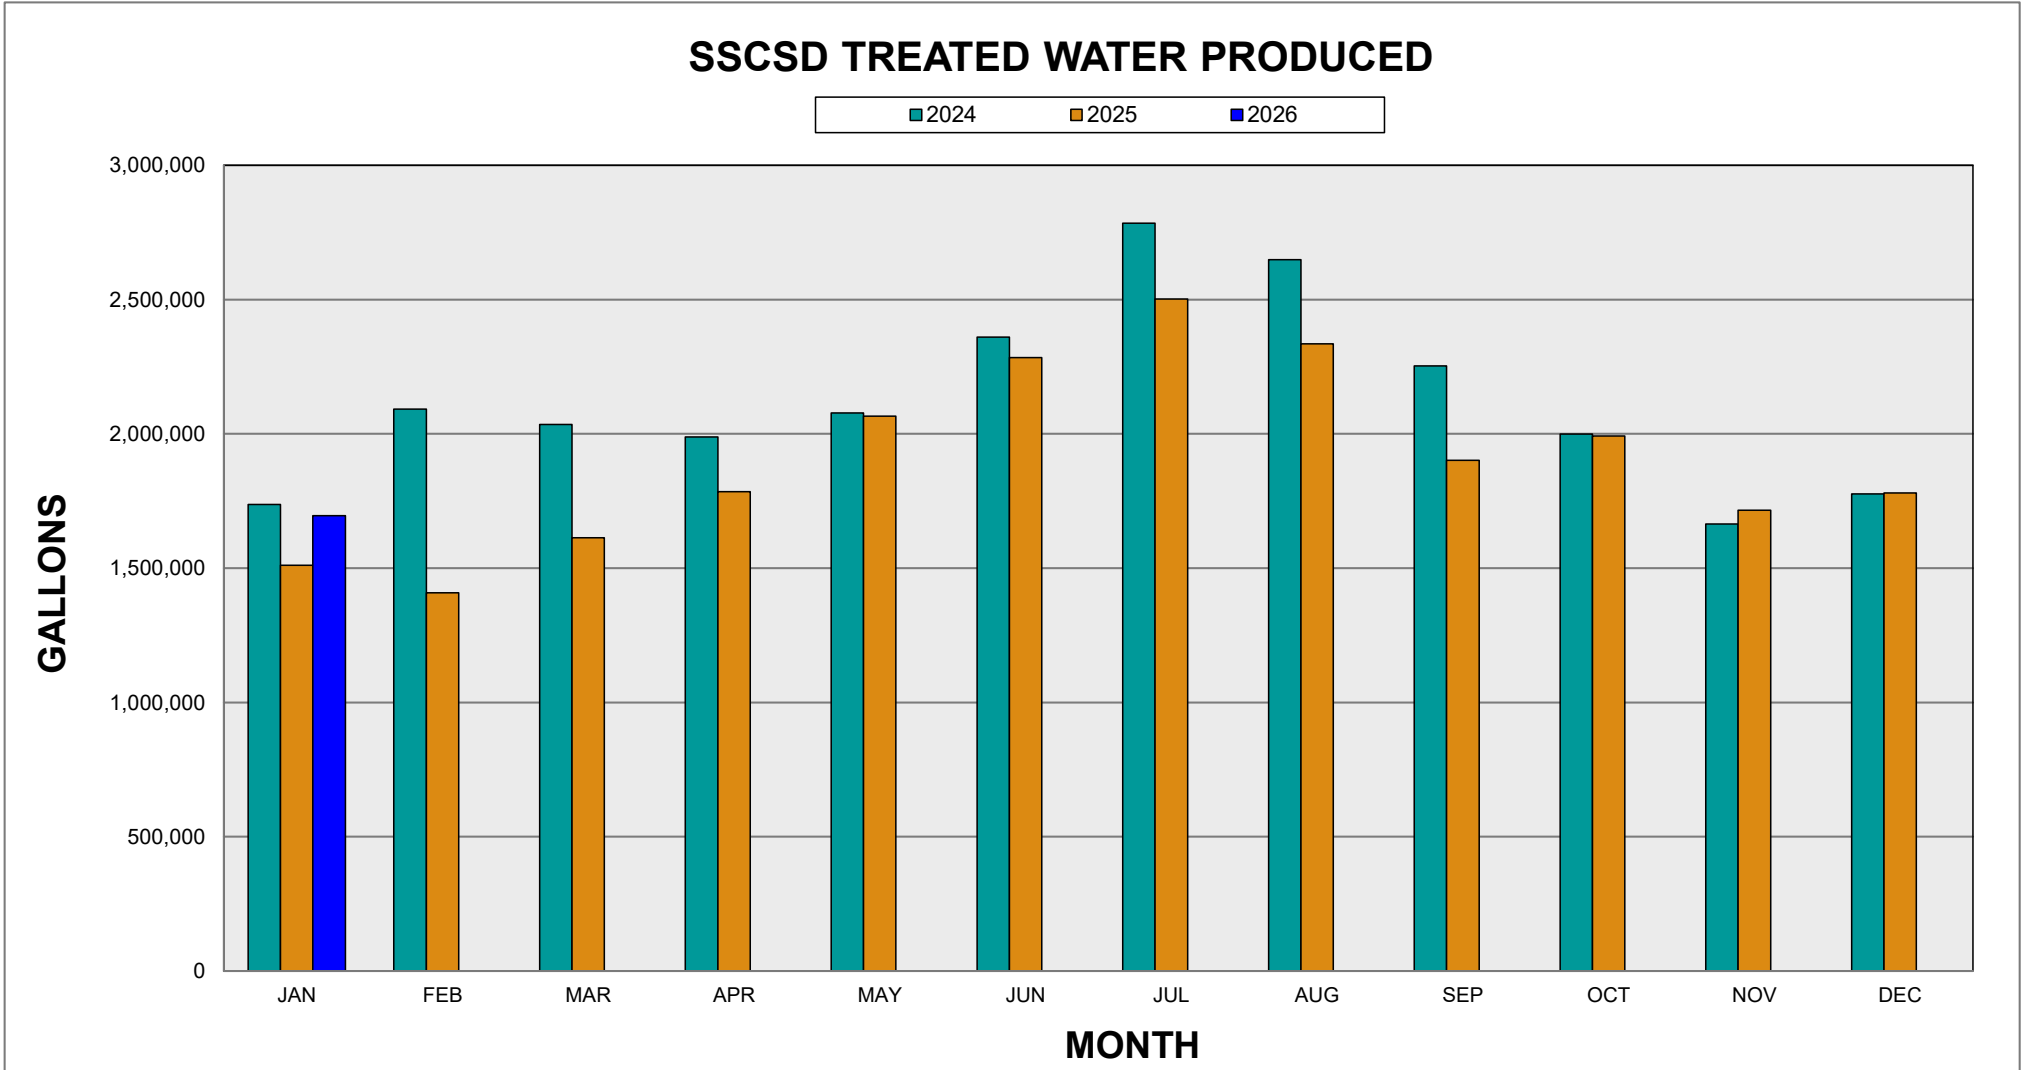


Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD TOTAL WATER SOLD (GALLONS)

MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,333,721	1,793,929	1,861,122	1,437,461	1,985,933	1,852,901	2,368,923	2,297,550	1,957,965	2,021,356	1,664,674	1,504,729
2025	1,615,807	1,393,330	1,487,809	1,584,795	1,914,865	1,767,733	2,811,321	2,153,470	1,701,992	1,672,835	1,220,856	1,850,141
2026												

SSCSD TOTAL WATER SOLD


■ 2024
 ■ 2025
 ■ 2026

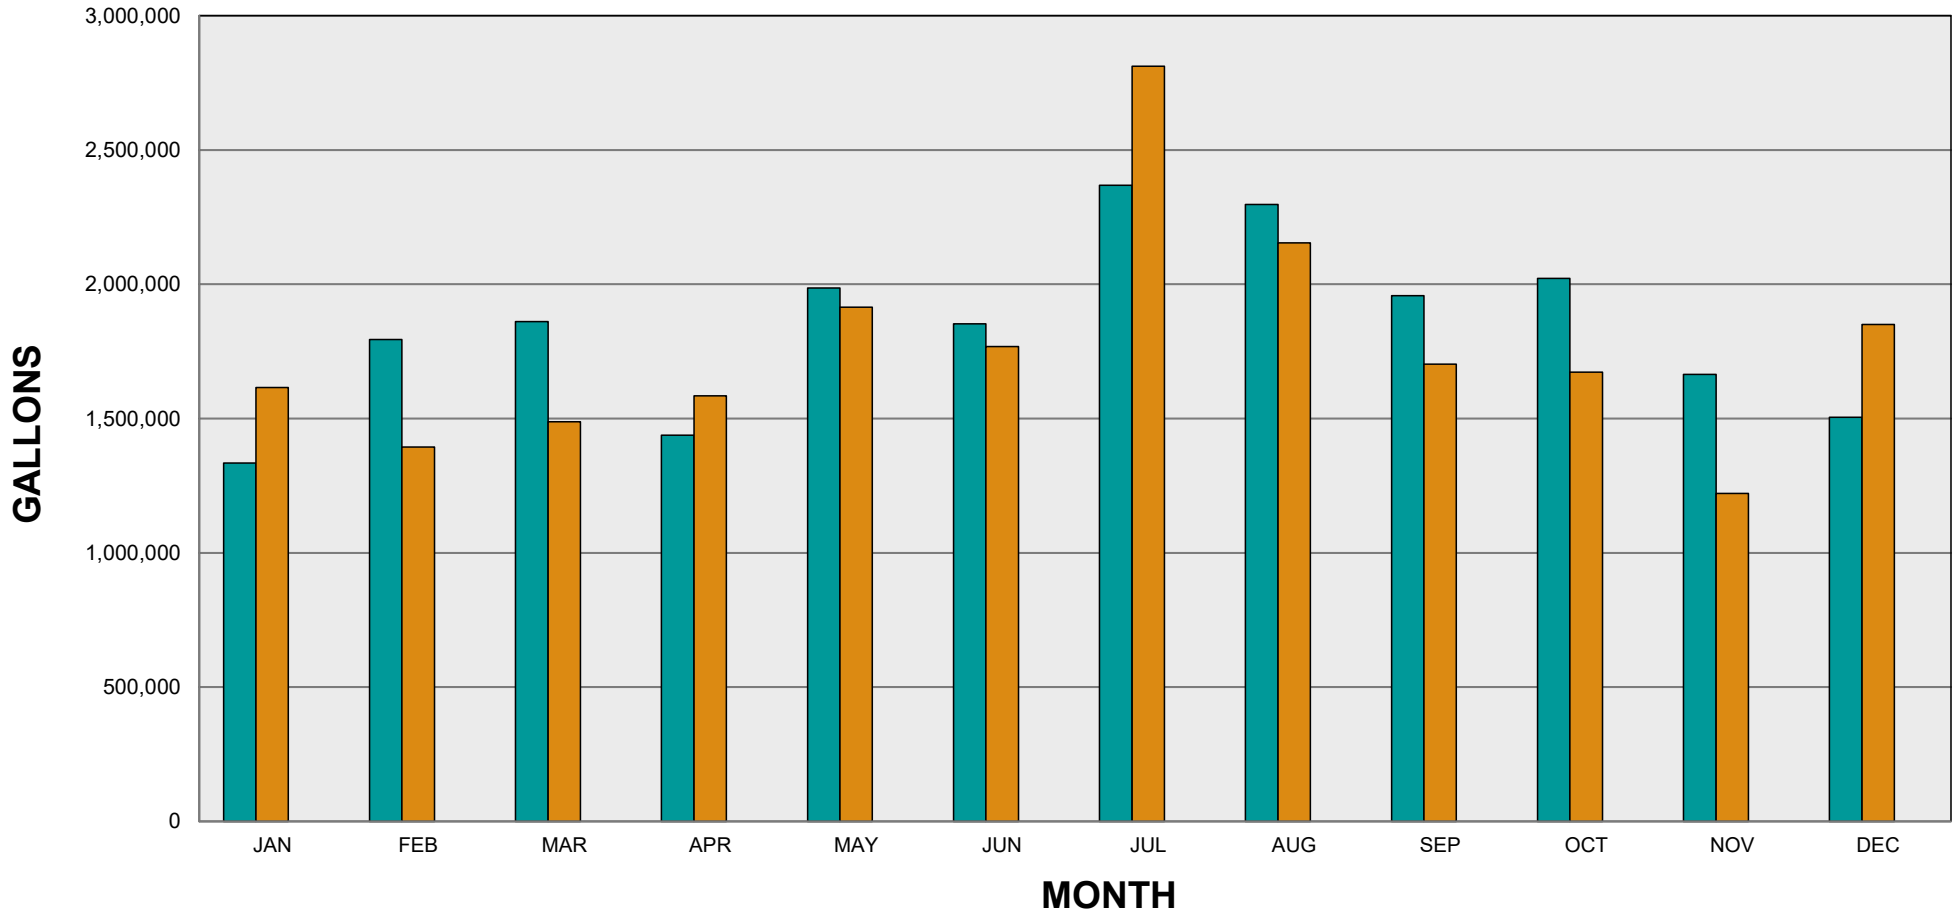

Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD WASTEWATER TREATMENT PLANT WATER USED (GALLONS)



MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	---	---	---	---	---	---	---	---	---	14,519	5,887	8,932
2025	6,082	6,815	9,119	6,665	7,870	7,047	7,555	6,456	28,815	6,747	6,112	7,548
2026	5,558											

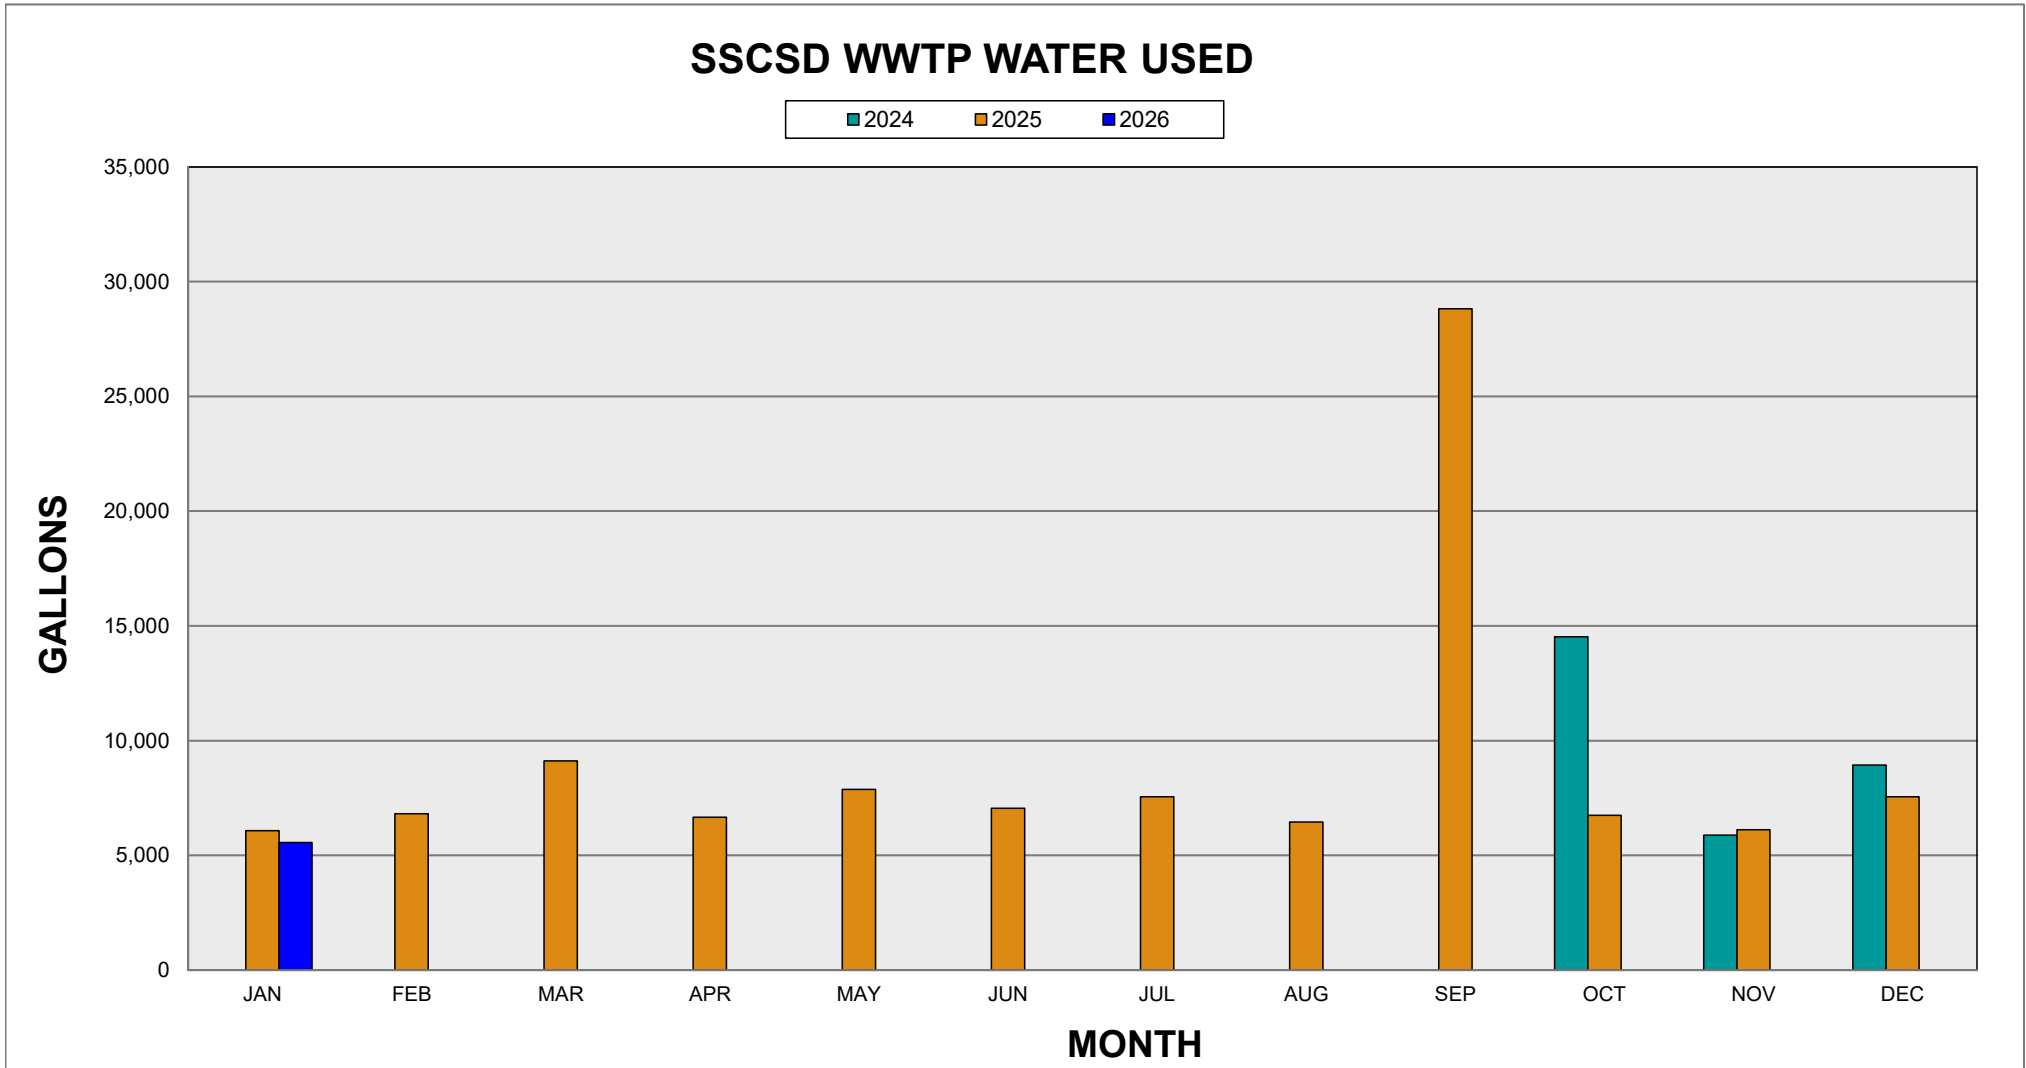

Data for this report is current up to 1/31, and is subject to change for future reporting.

SAN SIMEON CSD PRODUCTION DATA (GALLONS)

2023	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	---	---	---	---	---	---	---	---	2,187,977	2,207,872	1,951,981	2,103,226
TOTAL EFFLUENT FLOW (GAL)	---	---	---	---	---	---	---	---	1,873,570	1,951,950	1,830,260	2,114,900
2024	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,845,466
TOTAL EFFLUENT FLOW (GAL)	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
TOTAL EFFLUENT FLOW (GAL)	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	1,695,978											
TOTAL EFFLUENT FLOW (GAL)	1,936,510											

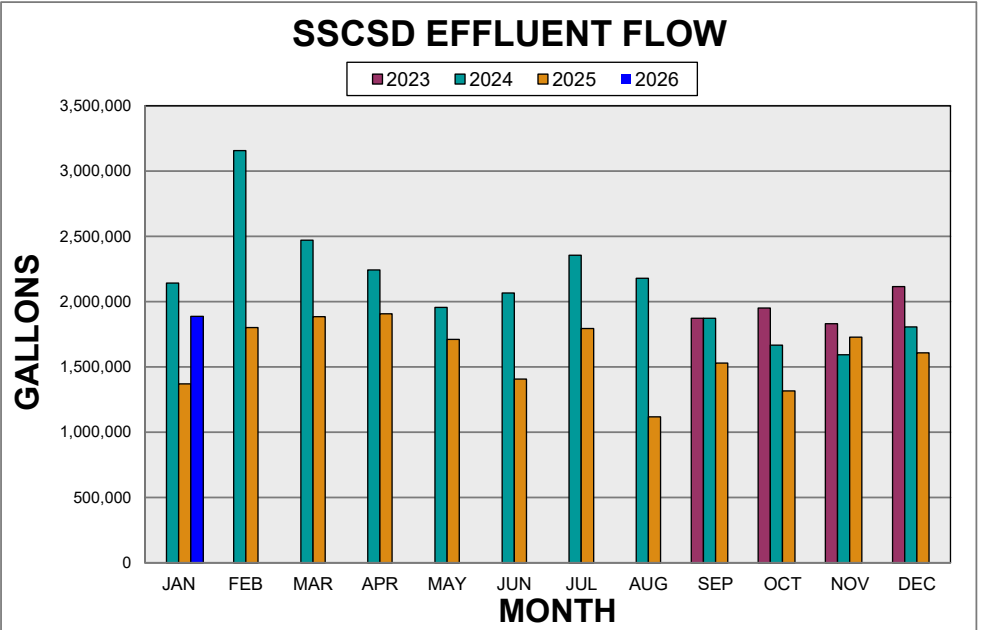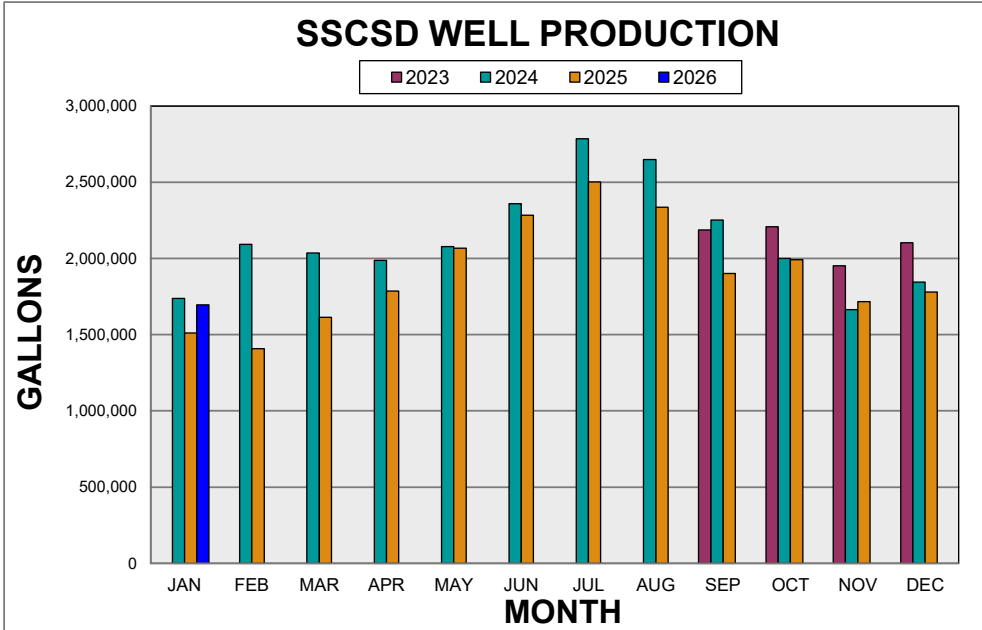

Data for this report is current up to 1/31, and is subject to change for future reporting.