October 29, 2026

San Simeon Community Services District
111 Pico Avenue
San Simeon, CA 93452

SUBJECT: OCTOBER 2026 MONTHLY FACILITY REPORT FOR THE SAN SIMEON COMMUNITY SERVICES DISTRICT WASTEWATER TREATMENT PLANT, WATER SYSTEM, AND COLLECTION SYSTEM

WASTEWATER TREATMENT PLANT

Annual generator servicing was completed at the WWTP and wellsite. The wellsite generator had fuel and coolant leaks which were repaired at the same time.

WATER SYSTEM

FRM staff completed the remaining repairs that were needed for the water storage reservoir roofing & framing on October 9, 2026.

The analyzer probes for chlorine and pH were observed to be malfunctioning, so both probes were replaced by FRM staff.

The routine bacteriological samples collected on October 19, 2026, came back with a minor detection of Total Coliform at Sample Station #1, and was Non-Detect for E. coli. Within 24-hours of receiving results, follow-up samples were collected by FRM staff throughout the distribution system and at both wells on October 21, 2026. All locations were Non-Detect for all coliforms. Staff reported all results to the regulator as they were received, and no further action was required.

The check valve for Well #2 had a minor leak, which required disassembly and repair.

COMPLIANCE

Staff compiled the data to complete the monthly Self-Monitoring Report (SMR) in California Integrated Water Quality System (CIWQS). Staff also compiled the data to complete the NPDES Permit Renewal Application, which is required by the Regional Water Quality Control Board (RWQCB) once per permit term. Once approved, the reports are uploaded into CIWQS and certified by SSCSD Staff.

Sincerely,
FLUID RESOURCE MANAGEMENT

California Regional Water Quality Control Board, Central Coast Region

Monthly report due first day of second month following monitoring period

Annual report due January 30

San Simeon CSD Wastewater Treatment Facility

DISCHARGER SELF-MONITORING
ORDER R3-2022-0003
NPDES CA0047961
WDID 3 400110001

Month: OCTOBER 2026

Date	Influent Flow Total (GPD)	Effluent Flow Total (GPD)	Effluent Monitoring					
			Biweekly Total Coliform	Biweekly Fecal Coliform	Biweekly Entero-coccus	Daily Settleable Solids (mL/L)	Daily Chlorine Used (lbs)	Daily Chlorine Residual (mg/L)
1	46,387	30,950				<0.1	139.2	0.03
2	46,394	30,410				<0.1	179.0	0.03
3	71,566	57,410				<0.1	143.2	0.05
4	37,096	32,300				<0.1	15.9	0.02
5	87,110	66,400				<0.1	218.8	0.05
6	59,067	64,060	<1.8	<1.8	<1.0	<0.1	198.9	0.06
7	37,918	36,790	<1.8	<1.8	<1.0	<0.1	103.4	0.02
8	51,032	50,040				<0.1	148.5	0.07
9	52,566	46,520				<0.1	222.8	0.05
10	60,974	55,170				<0.1	147.2	0.04
11	53,897	44,920				<0.1	59.7	0.03
12	89,302	72,480				<0.1	230.7	0.04
13	51,923	53,620	<1.8	<1.8	<1.0	<0.1	159.1	0.05
14	42,758	47,530	<1.8	<1.8	<1.0	<0.1	175.0	0.04
15	45,145	49,160				<0.1	268.9	0.05
16	40,230	38,250				<0.1	136.8	0.09
17	64,049	56,800					131.3	0.05
18	50,523	48,580				<0.1	59.7	0.03
19	63,194	55,160					163.2	0.04
20	65,247	44,900					179.0	0.04
21	37,395	65,540					139.2	0.05
22	56,419	71,900					154.3	0.05
23	55,250	74,840					195.7	0.05
24	46,200	35,840					131.3	0.06
25	40,544	23,870					55.7	0.04
26	70,990	39,260					178.5	0.05
27	48,444	70,680					171.1	0.05
28	32,787	16,880					107.4	0.05
29								
30								
31								
Min	32,787	16,880	<1.8	<1.8	<1.0	<0.1	15.9	0.02
Mean	53,728.8	49,295.0	<1.8	<1.8	<1.0	<0.1	150.5	0.05
Max	89,302	74,840	<1.8	<1.8	<1.0	<0.1	268.9	0.09
Total	1,504,407	1,380,260	*Effluent average dry weather flow NTE a monthly average of 0.2 MGD.*					

Effluent and Influent Monitoring

Date	Monthly Effluent BOD (24 HC)	Monthly Effluent TSS (24 HC)	Monthly Influent BOD (24 HC)	Monthly Influent TSS (24 HC)
10/7/26	<4.0	<5.0	360	370
BOD Removal: 100.0%		TSS Removal: 100.0%		

Effluent Monitoring

Date	Weekly Dissolved Oxygen (Grab)	Weekly Turbidity (Grab)	Weekly pH (Grab)	Weekly Temp °F (Grab)
10/7/26	5.2	2.3	7.06	76.8
10/13/26	4.4	2.0	6.93	73.6
10/20/26				
10/27/26				
Min	4.4	2.0	6.93	73.6
Mean	4.8	2.2	7.00	75.2
Max	5.2	2.3	7.06	76.8

Sludge Removal

Date	Gallons
10/2/26	4,800

Influent Brine Received

Date	Gallons
N/A	N/A

Semi-Annual Effluent Oil & Grease

Date	Result (mg/L)
1/20/26	<5.0
7/22/26	<6.4

Effluent Limits

Parameter	Units	Monthly Avg	Weekly Avg	Daily Max
BOD	mg/L	30	45	90
Suspended Solids	mg/L	30	45	90
Oil and Grease	mg/L	25	40	75
Turbidity	NTU	75	100	225
Total Coliform	MPN/ 100 mL	30 Day Geometric Mean: 230		
		Daily Maxiumum: 2,400		
Chlorine Residual	mg/L	6 Month Median: 0.23		0.93
		Instantaneous Maximum: 6.9		
pH	pH units	Between 6.0 - 9.0		
Settleable Solids	mL/L	1.0	1.5	3.0
BOD/TSS Removal	%	≥ 85%	***	***

I certify under penalty of perjury that the foregoing is true and accurate and that the sampling procedure and analysis used are as specified in the Waste Discharge Order for this facility.


SIGNATURE: _____ **DATE:** _____

PRINTED NAME: _____ **TITLE:** _____

DRAFT

SAN SIMEON CSD AVERAGE DAILY EFFLUENT FLOW (GALLONS PER DAY)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
EFFLUENT DRY WEATHER AVERAGE DAILY FLOW LIMIT	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000	200,000
2024	69,123	108,920	79,757	74,812	63,117	68,885	76,021	70,269	62,465	53,768	53,148	58,262
2025	44,231	64,372	60,786	63,575	55,226	46,911	57,893	36,023	51,005	42,481	57,625	51,907
2026	62,468	68,708	52,826	52,146	48,391	55,233	61,281	63,858	42,928	49,295		

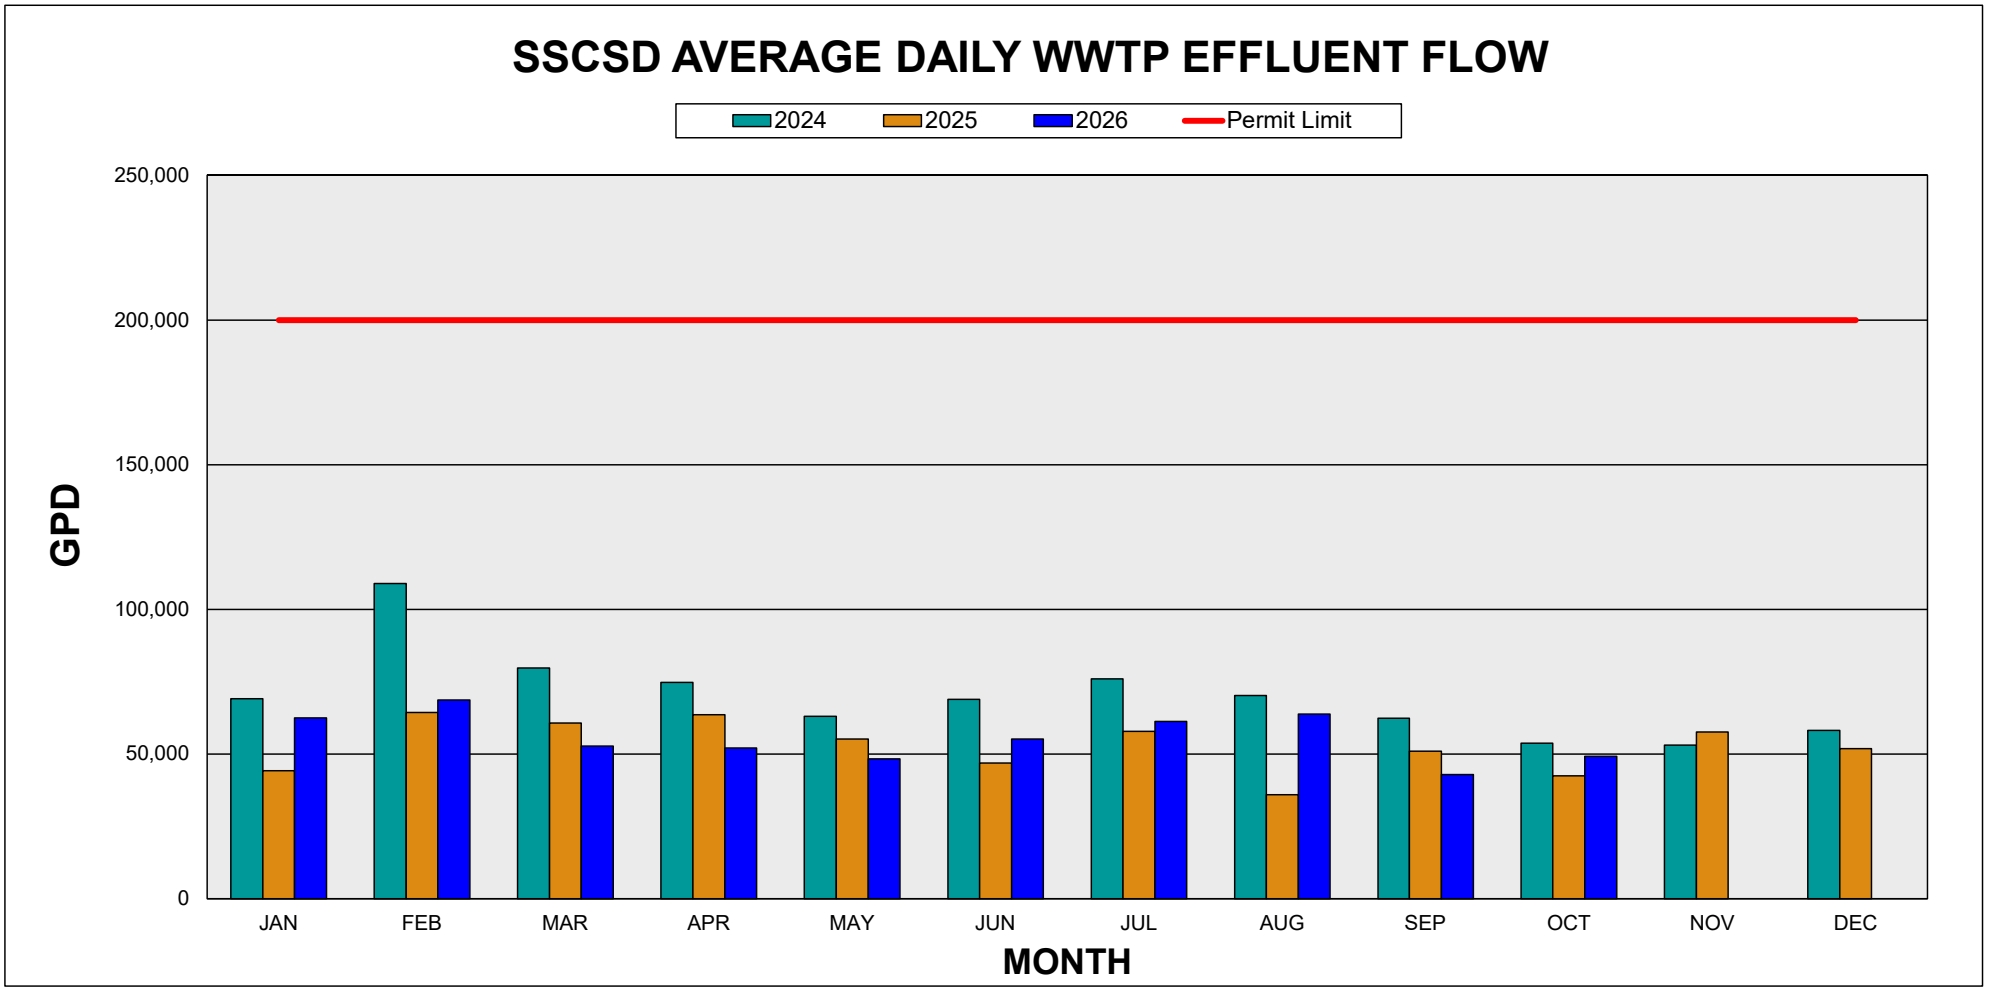

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL EFFLUENT FLOW (GALLONS)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	1,936,510	1,923,820	1,637,620	1,564,380	1,500,120	1,656,980	1,899,700	1,979,600	1,287,840	1,380,260		

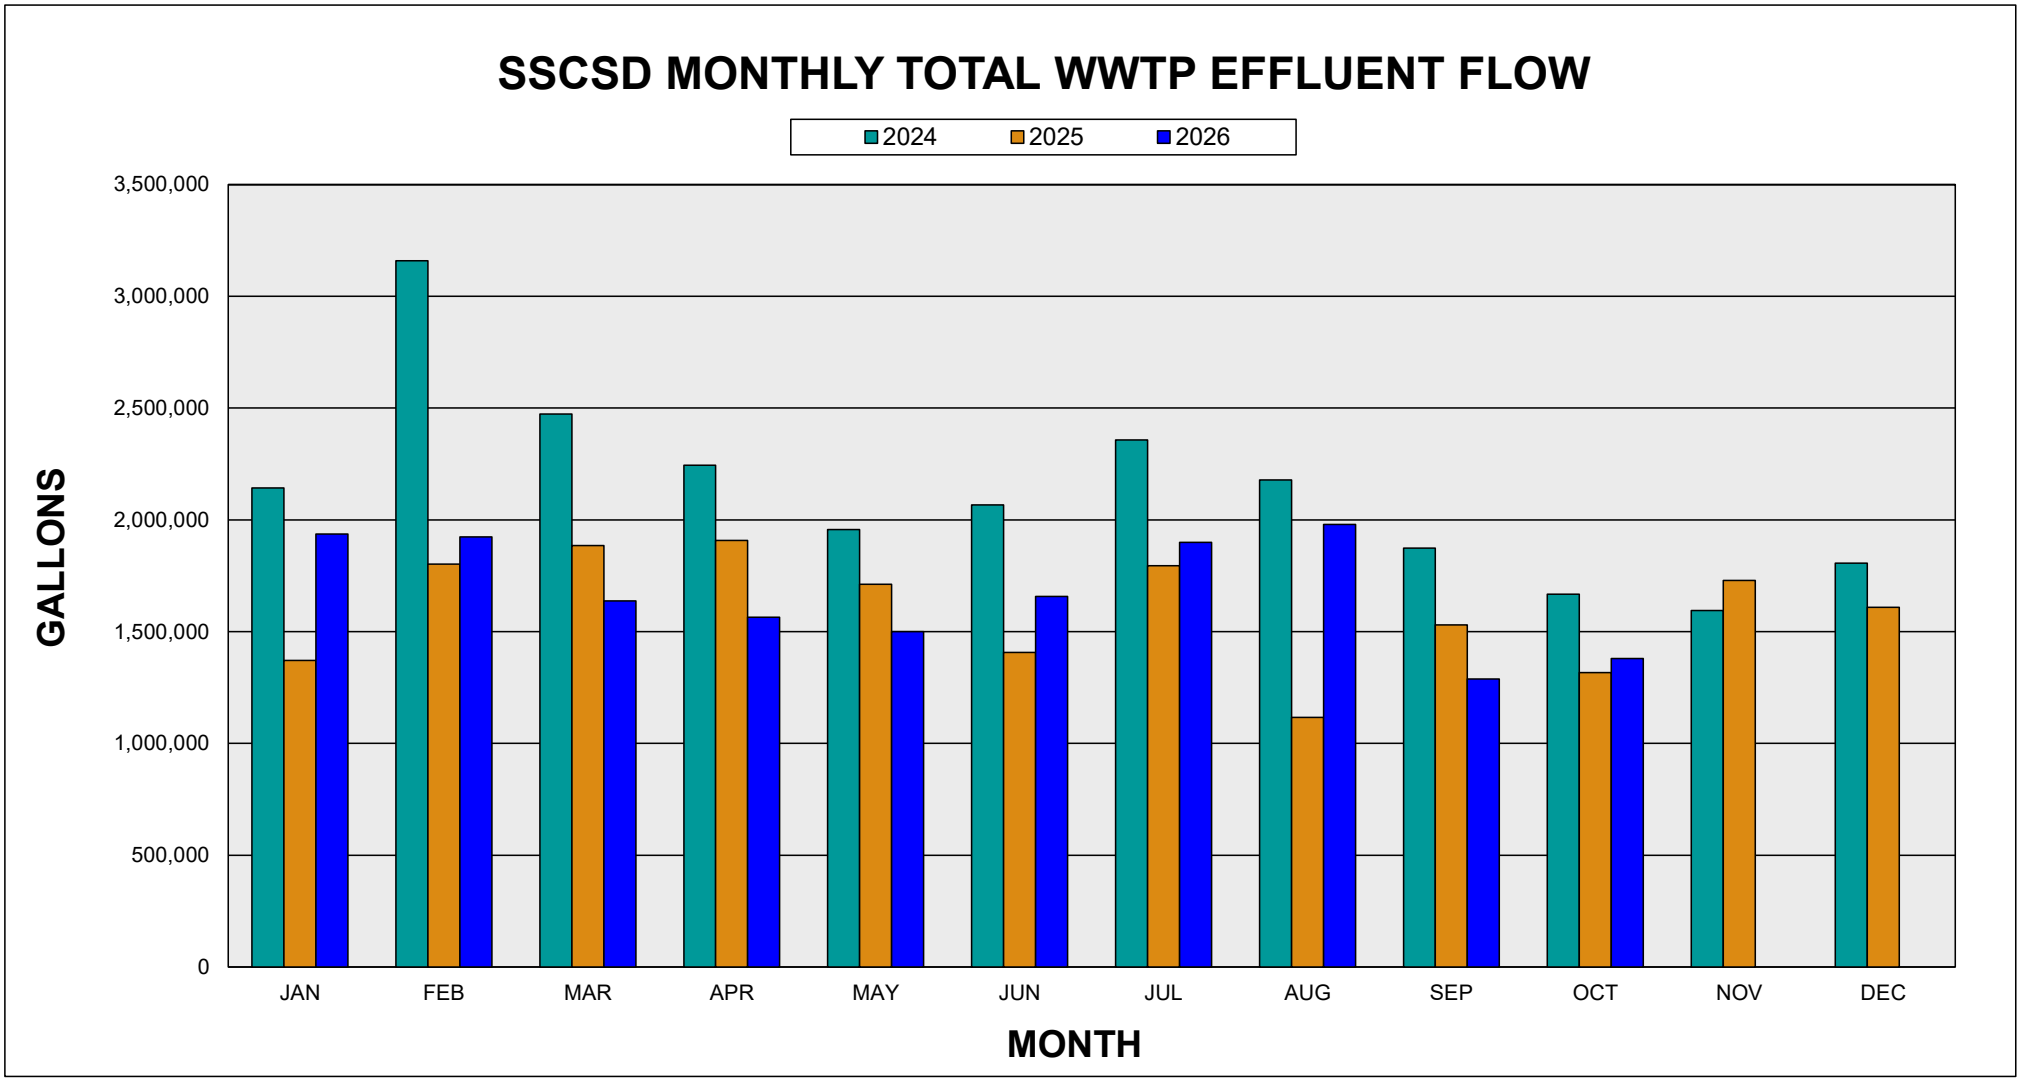

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD AVERAGE DAILY INFLUENT FLOW (GALLONS PER DAY)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	73,426	115,645	81,673	76,105	61,541	67,958	75,673	70,547	61,328	51,160	48,404	57,507
2025	42,268	61,220	58,891	56,049	55,635	61,765	69,394	62,696	60,055	54,337	60,496	56,579
2026	69,567	72,076	58,727	58,773	53,650	63,917	70,179	63,985	52,580	49,295		

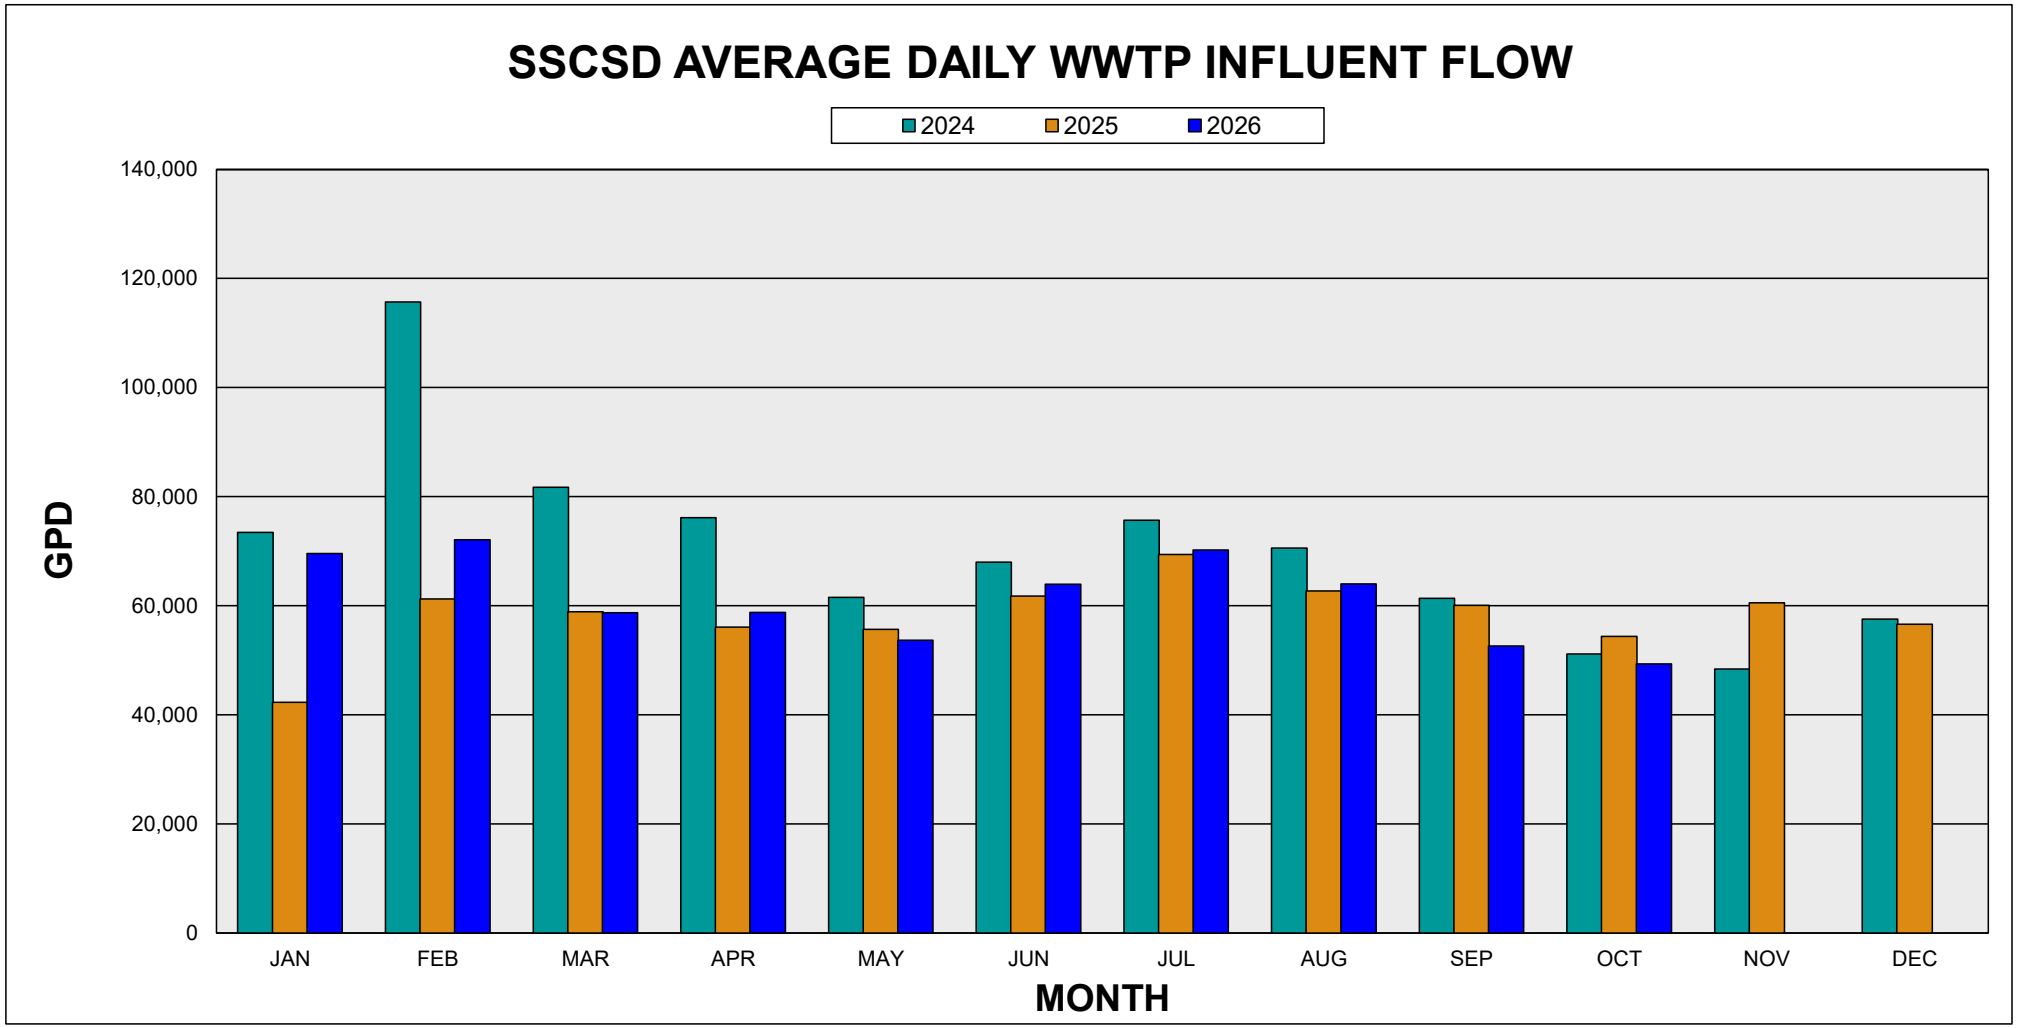

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD MONTHLY TOTAL INFLUENT FLOW (GALLONS)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	2,276,191	3,353,693	2,531,854	2,283,155	1,907,760	2,038,747	2,345,876	2,186,946	1,839,831	1,633,973	1,534,789	1,782,722
2025	1,310,305	1,714,171	1,825,606	1,681,465	1,724,693	1,852,964	2,151,214	1,943,565	1,801,654	1,684,454	1,814,894	1,753,949
2026	2,156,572	2,018,115	1,820,537	1,763,199	1,663,139	1,917,512	2,175,561	1,983,542	1,577,410			

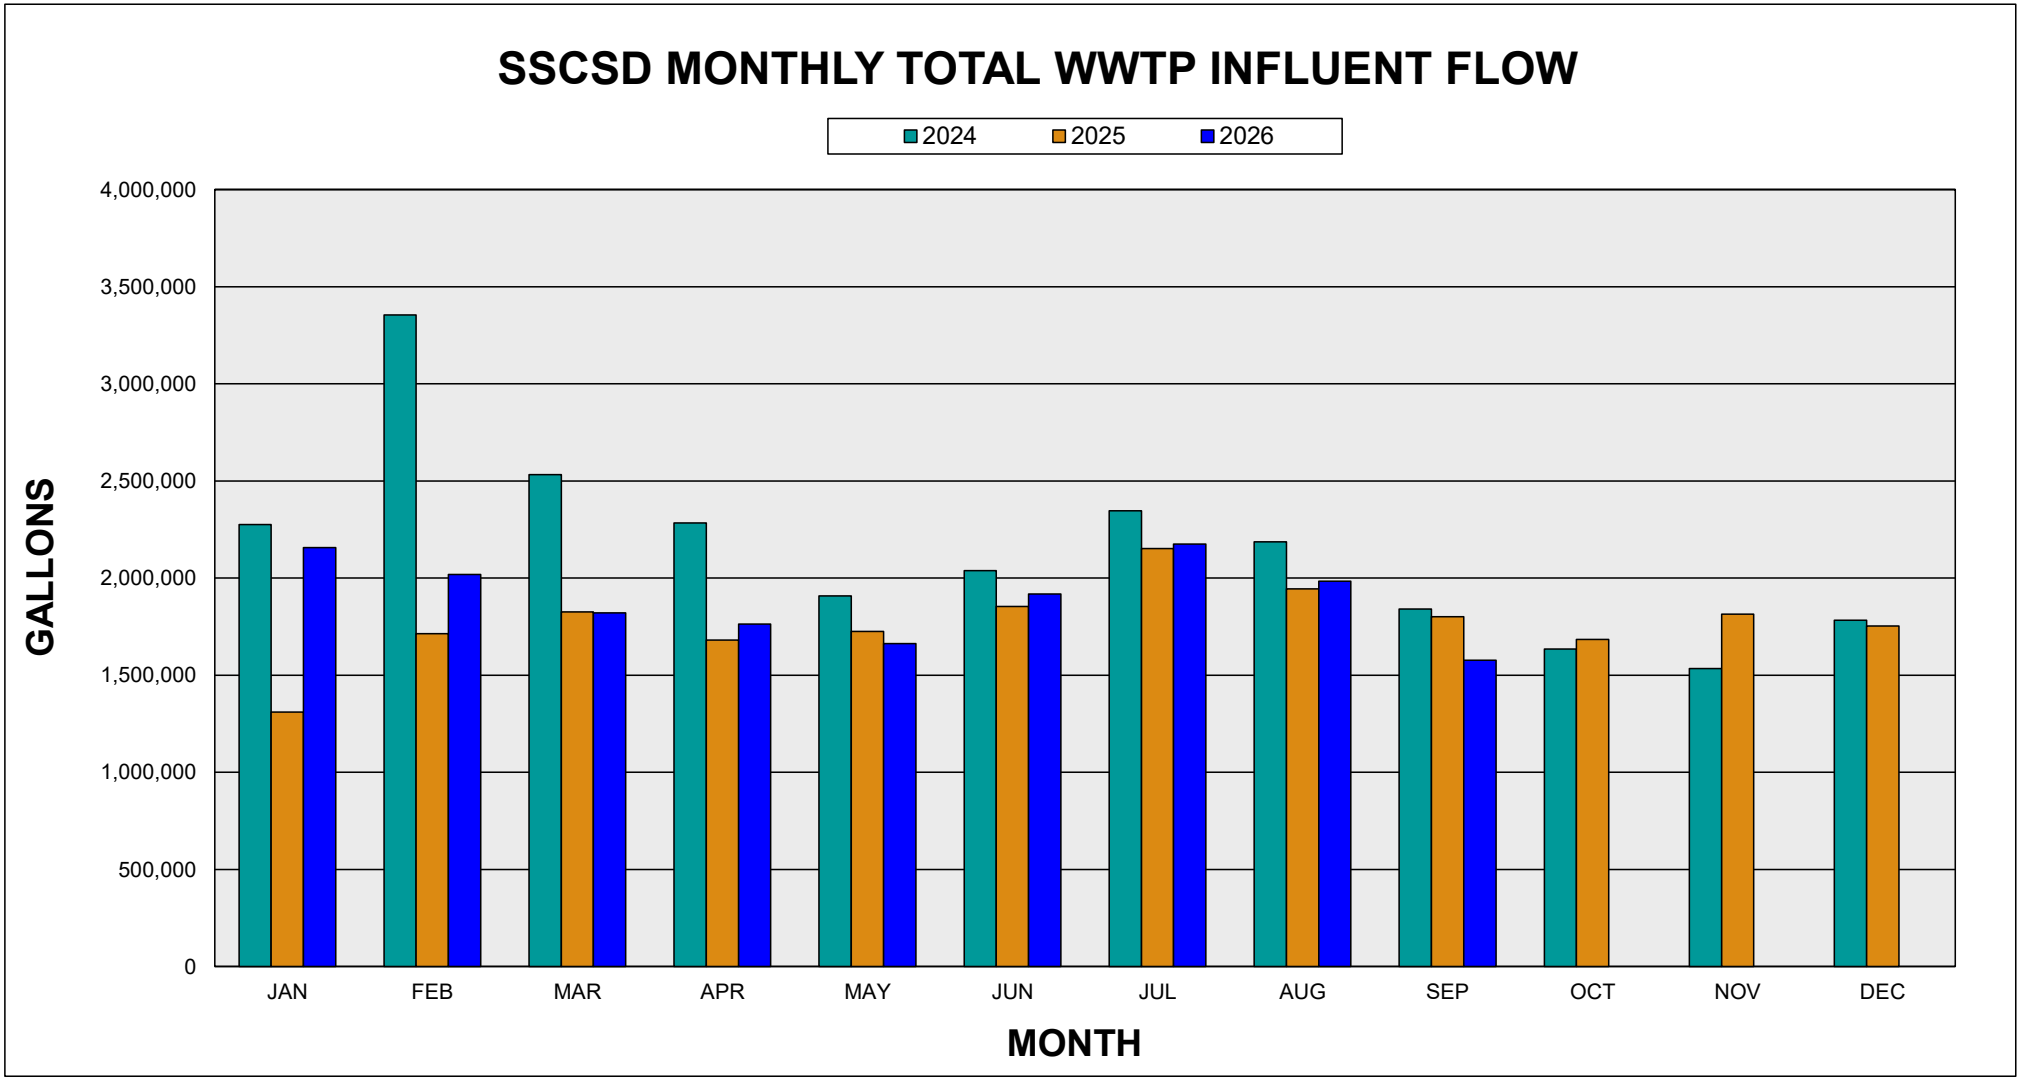

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD TREATED WATER PRODUCED (GALLONS)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,776,950
2025	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
2026	1,679,335	1,789,216	2,029,698	1,993,944	2,099,412	2,238,935	2,615,756	2,471,242	2,030,596	1,877,480		

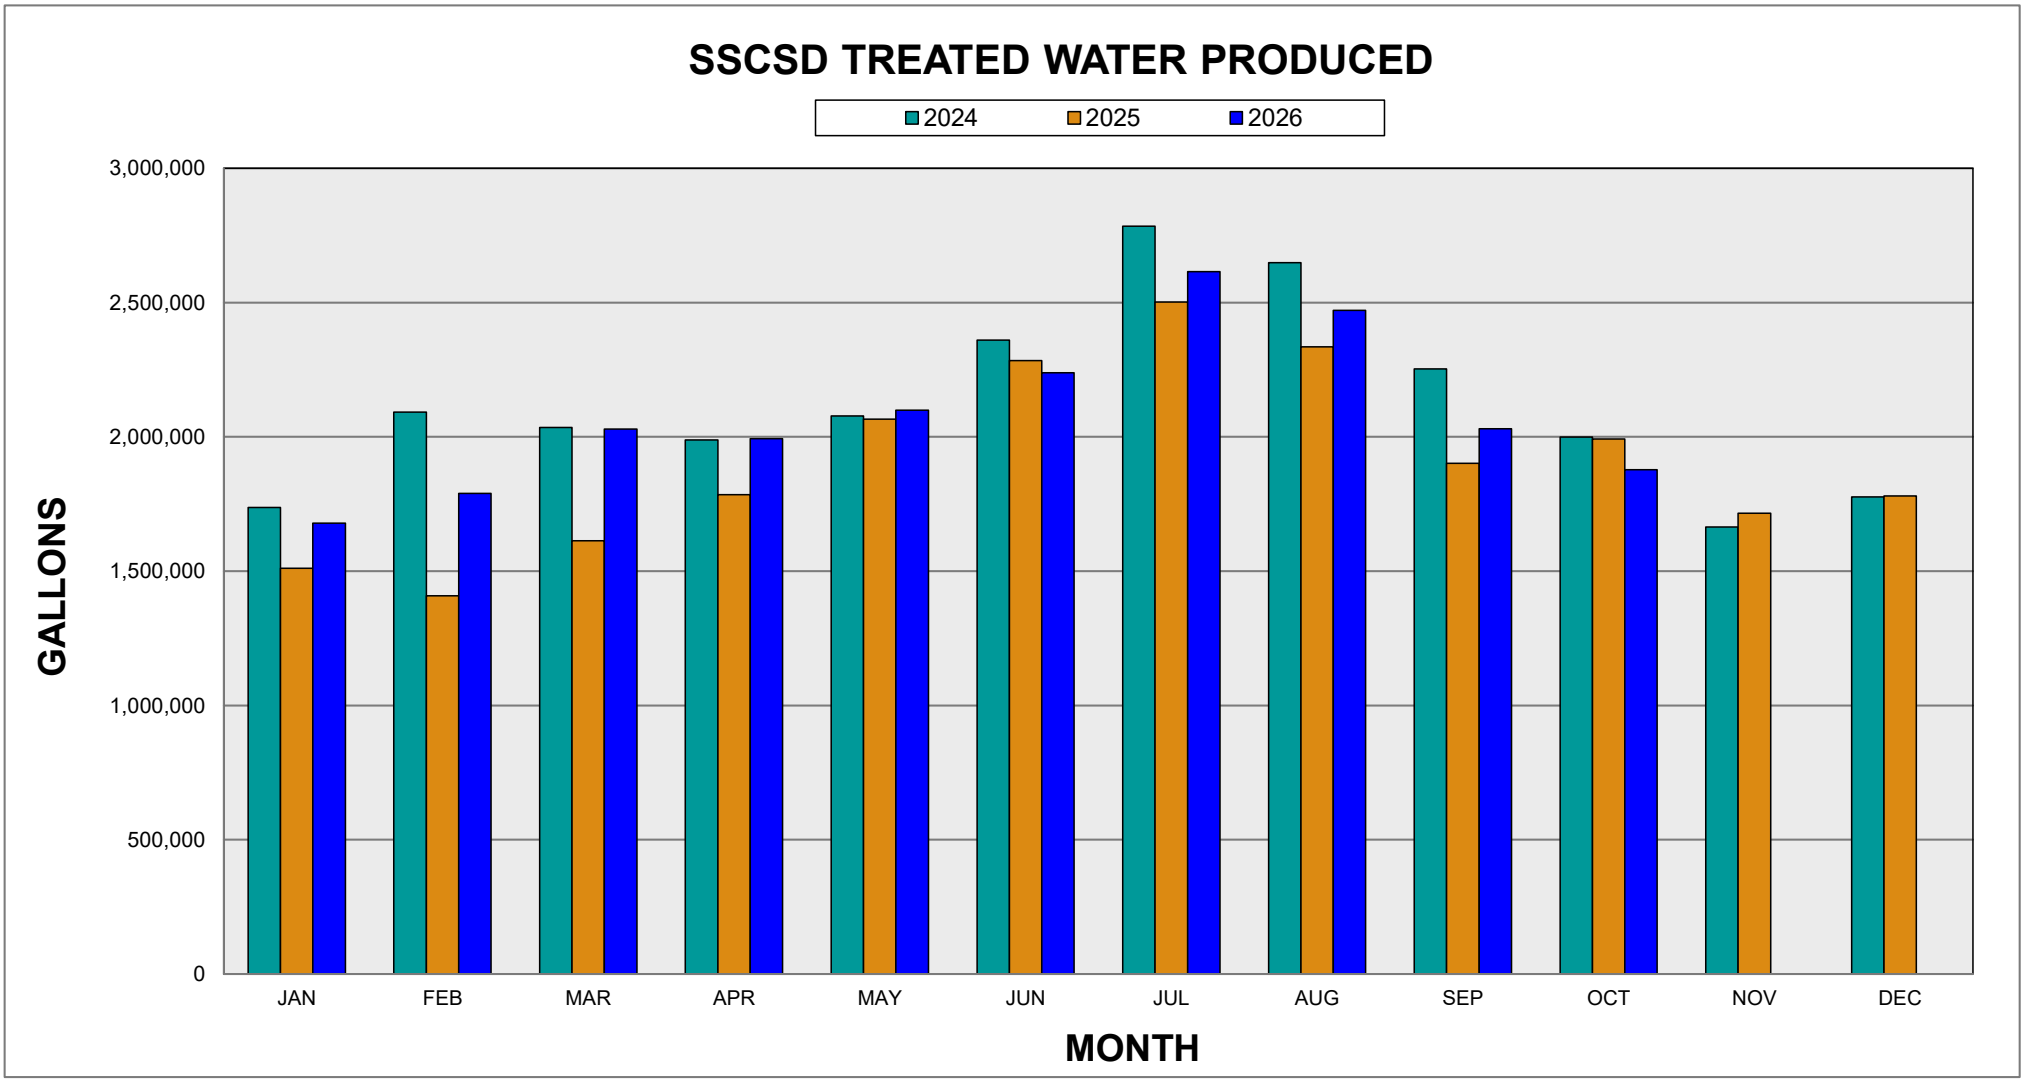

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD TOTAL WATER SOLD (GALLONS)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	1,333,721	1,793,929	1,861,122	1,437,461	1,985,933	1,852,901	2,368,923	2,297,550	1,957,965	2,021,356	1,664,674	1,504,729
2025	1,615,807	1,393,330	1,487,809	1,584,795	1,914,865	1,767,733	2,811,321	2,153,470	1,701,992	1,672,835	1,220,856	1,850,141
2026	1,352,339	1,381,122	1,592,941	2,005,942	1,852,130	1,885,304	2,102,134	2,614,432	1,734,769			

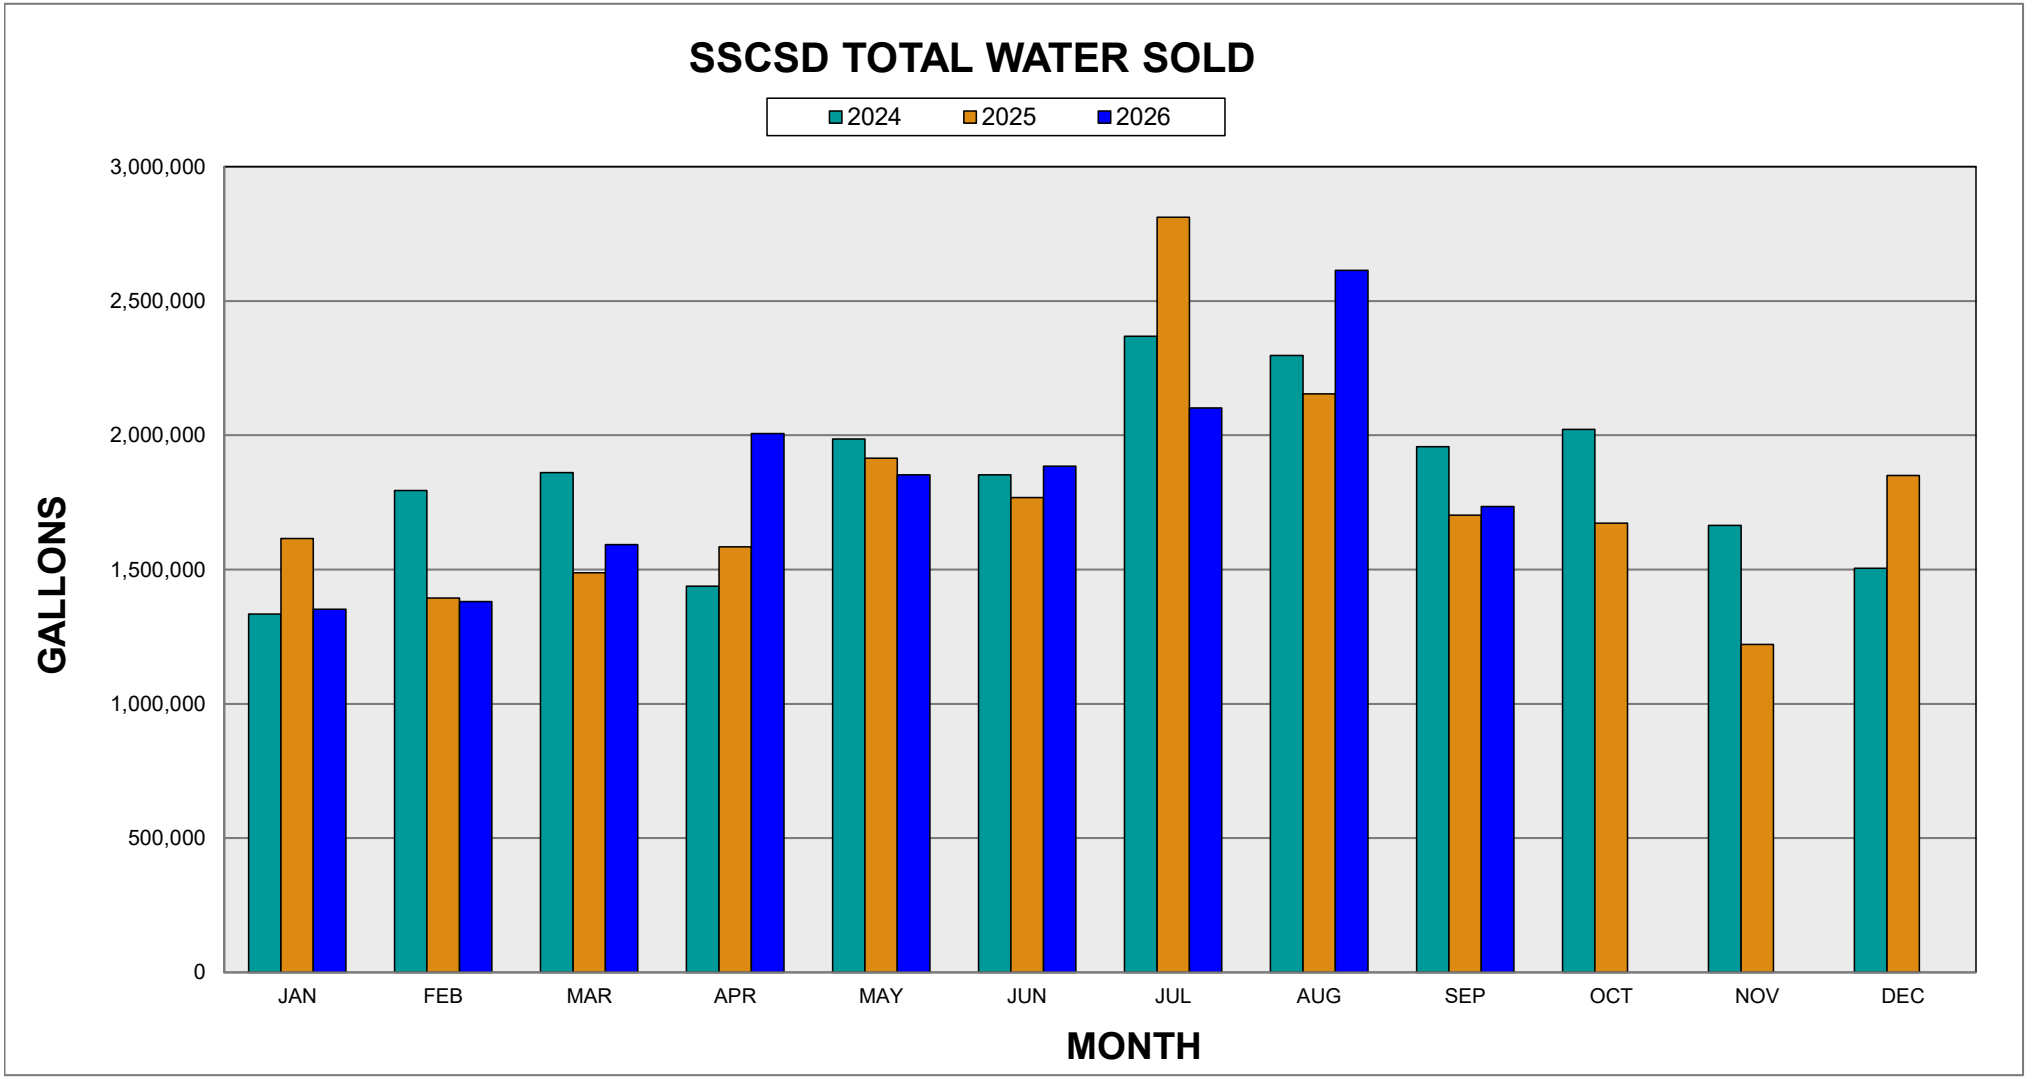

Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD WASTEWATER TREATMENT PLANT WATER USED (GALLONS)


MONTH	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
2024	---	---	---	---	---	---	---	---	---	14,519	5,887	8,932
2025	6,082	6,815	9,119	6,665	7,870	7,047	7,555	6,456	28,815	6,747	6,112	7,548
2026	5,558	5,461	8,655	6,321	8,012	5,334	6,860	10,989	7,982	10,600		

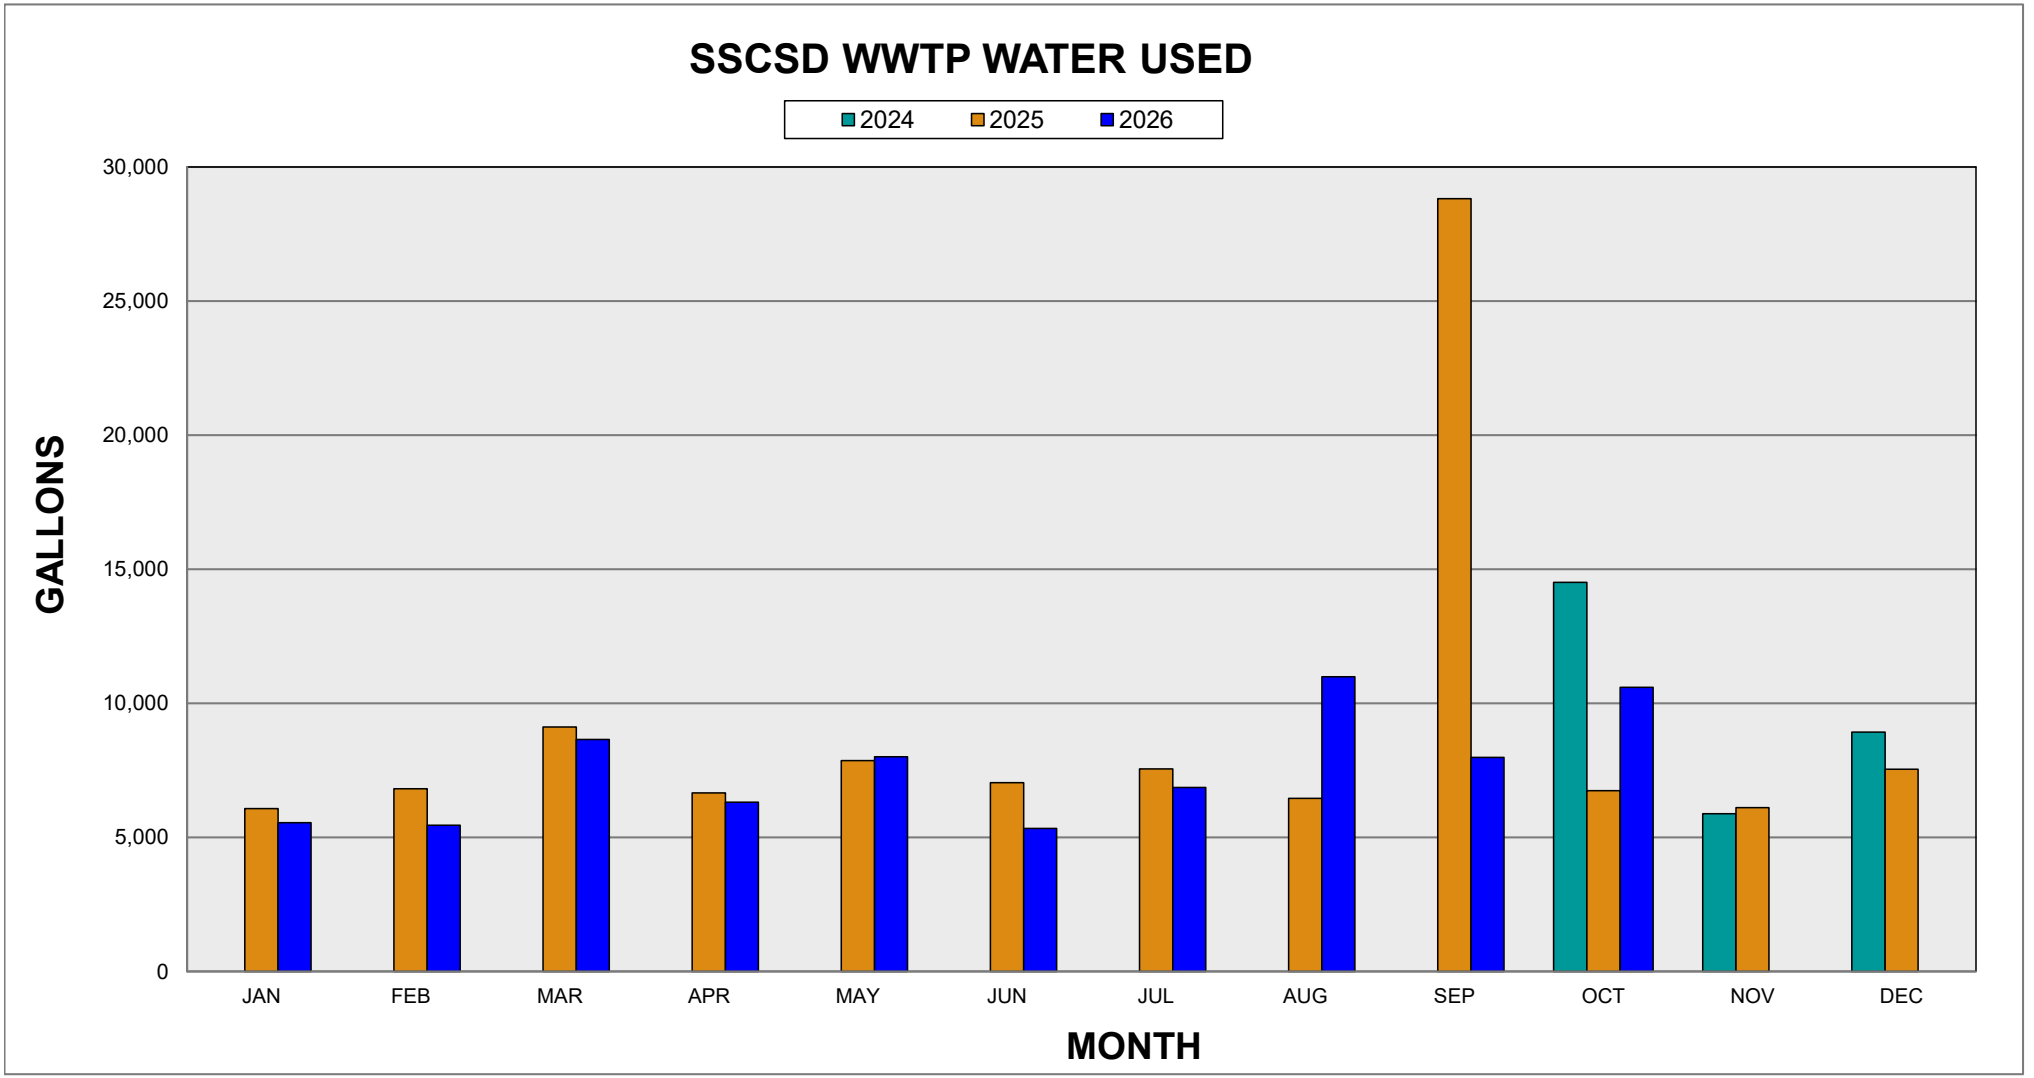


Data for this report is current up to 10/29, and is subject to change for future reporting.

SAN SIMEON CSD PRODUCTION DATA (GALLONS)

2023	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
WELL PRODUCTION (GAL)	---	---	---	---	---	---	---	---	2,187,977	2,207,872	1,951,981	2,103,226
TOTAL EFFLUENT FLOW (GAL)	---	---	---	---	---	---	---	---	1,873,570	1,951,950	1,830,260	2,114,900
2024	**JAN**	**FEB**	**MAR**	**APR**	**MAY**	**JUN**	**JUL**	**AUG**	**SEP**	**OCT**	**NOV**	**DEC**
WELL PRODUCTION (GAL)	1,737,454	2,092,680	2,035,383	1,988,184	2,078,094	2,360,015	2,784,954	2,648,144	2,253,051	1,999,404	1,664,674	1,845,466
TOTAL EFFLUENT FLOW (GAL)	2,142,810	3,158,680	2,472,480	2,244,350	1,956,640	2,066,560	2,356,660	2,178,350	1,873,940	1,666,818	1,594,430	1,806,120
2025	**JAN**	**FEB**	**MAR**	**APR**	**MAY**	**JUN**	**JUL**	**AUG**	**SEP**	**OCT**	**NOV**	**DEC**
WELL PRODUCTION (GAL)	1,511,184	1,408,559	1,613,586	1,785,476	2,066,524	2,283,868	2,502,210	2,335,854	1,901,940	1,991,924	1,715,762	1,780,116
TOTAL EFFLUENT FLOW (GAL)	1,371,160	1,802,420	1,884,380	1,907,240	1,712,020	1,407,320	1,794,690	1,116,700	1,530,160	1,316,920	1,728,760	1,609,120
2026	**JAN**	**FEB**	**MAR**	**APR**	**MAY**	**JUN**	**JUL**	**AUG**	**SEP**	**OCT**	**NOV**	**DEC**
WELL PRODUCTION (GAL)	1,679,335	1,789,216	2,029,698	1,993,944	2,099,412	2,238,935	2,615,756	2,471,242	2,030,596	1,877,480		
TOTAL EFFLUENT FLOW (GAL)	1,936,510	1,923,820	1,637,620	1,564,380	1,500,120	1,656,980	1,899,700	1,979,600	1,287,840	1,380,260		

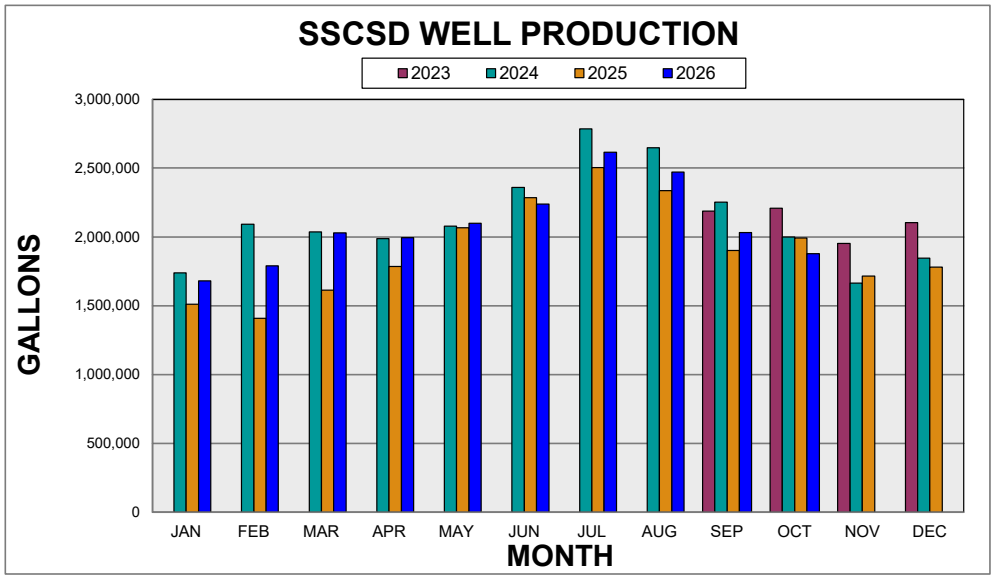

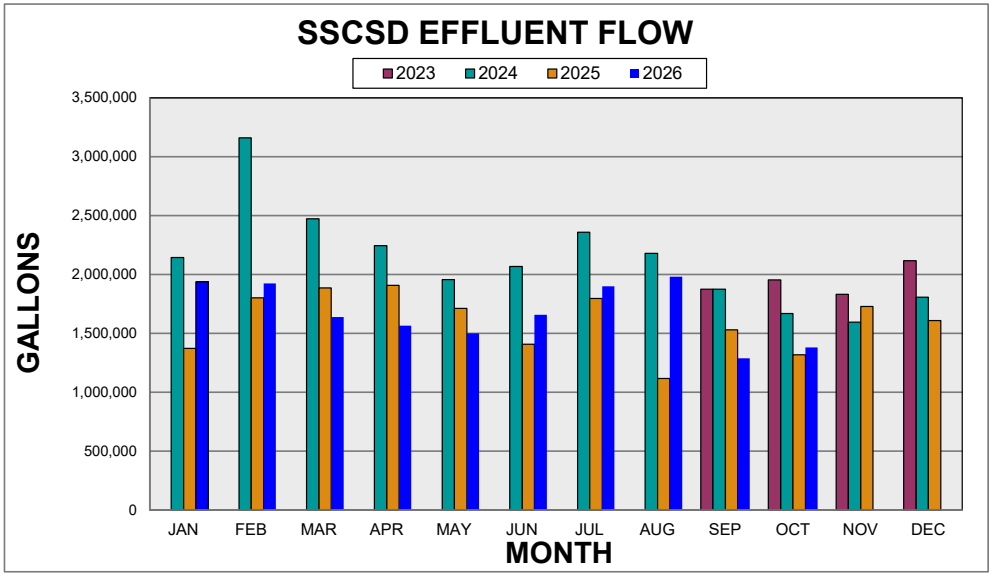

Data for this report is current up to 10/29, and is subject to change for future reporting.